


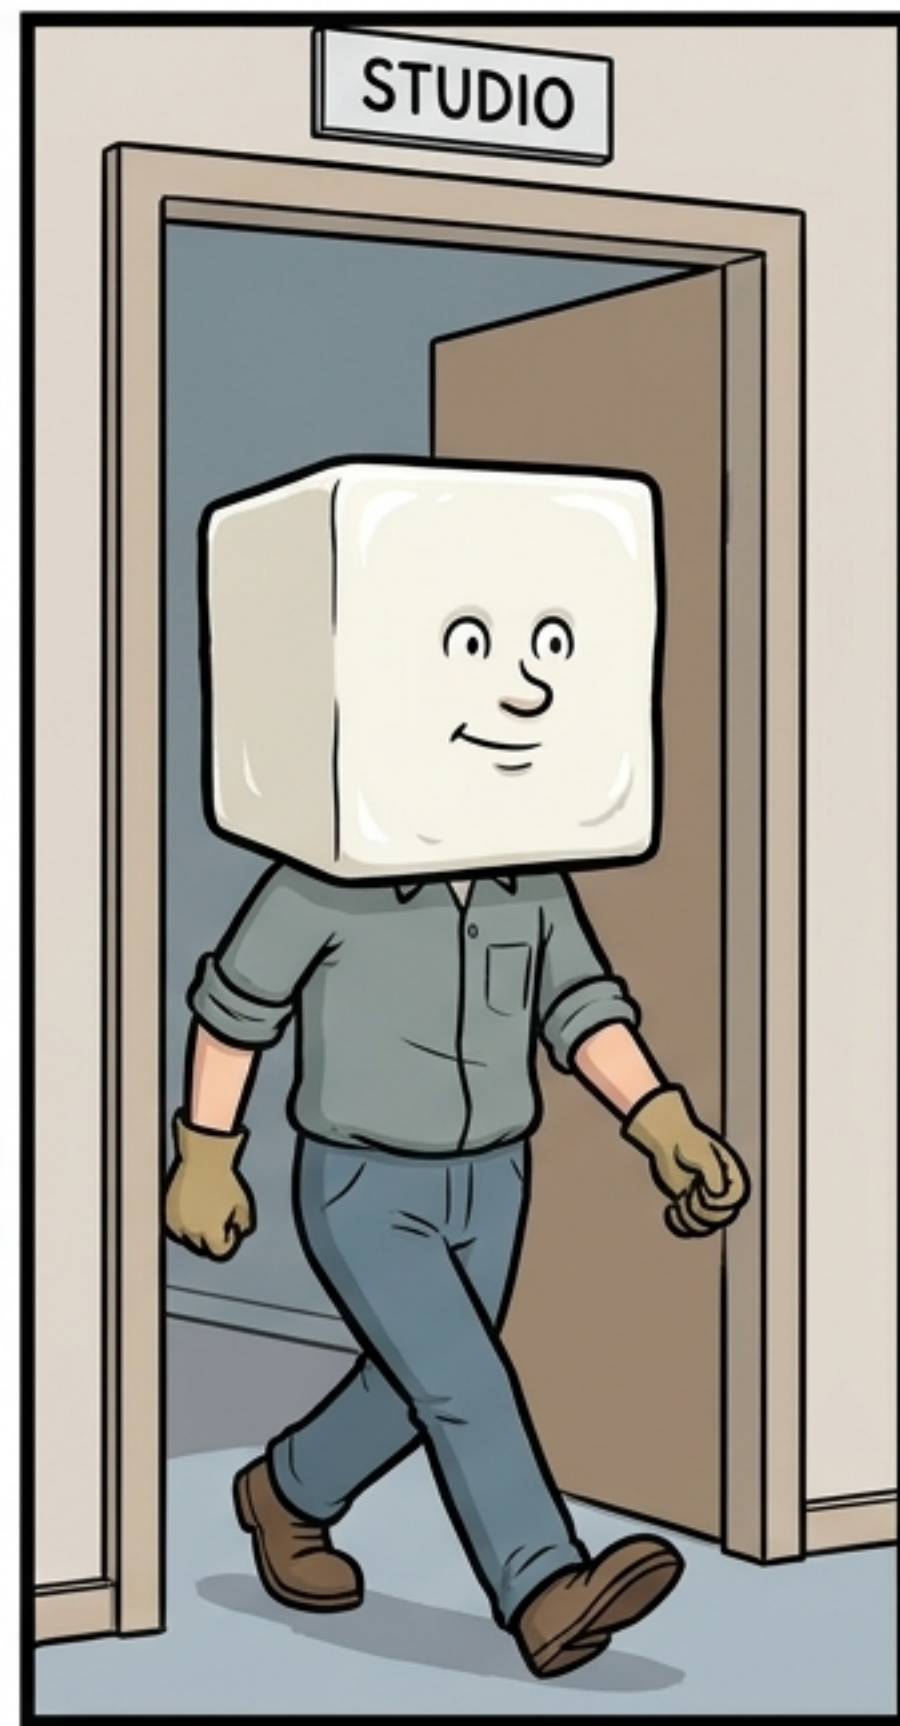

Products designed to combat medication dryness are not suitable for application inside healing piercings.
Ear masonry remains an underappreciated architectural discipline.