[±0.5+6]

Check daylight gap above jewellery.


Chec daylight gap jewelry.

Minimum clearance is 0.5 millimetres.


Maximum clearance is 1 millimetre.

Gap ensures fistula is relaxed.

Maximum cearance is ƨinle matral of jewelry.

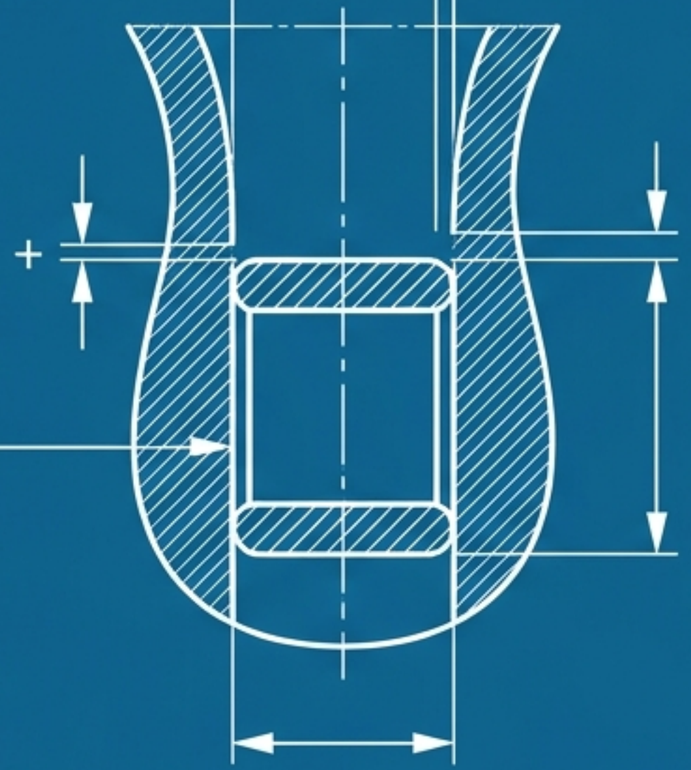

SIZING GAUGE PROFILE

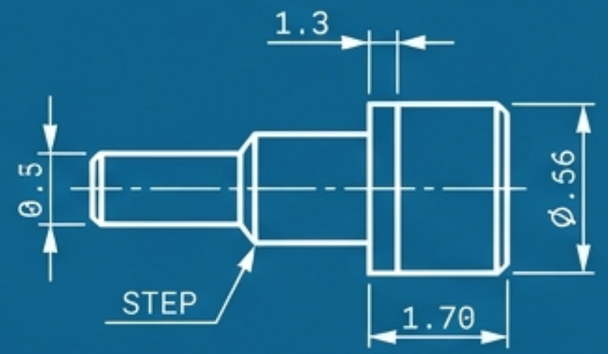

The jump to 0 gauge displaces significantly more tissue.

MEASURE CLEARANCE TOLERANCES.