


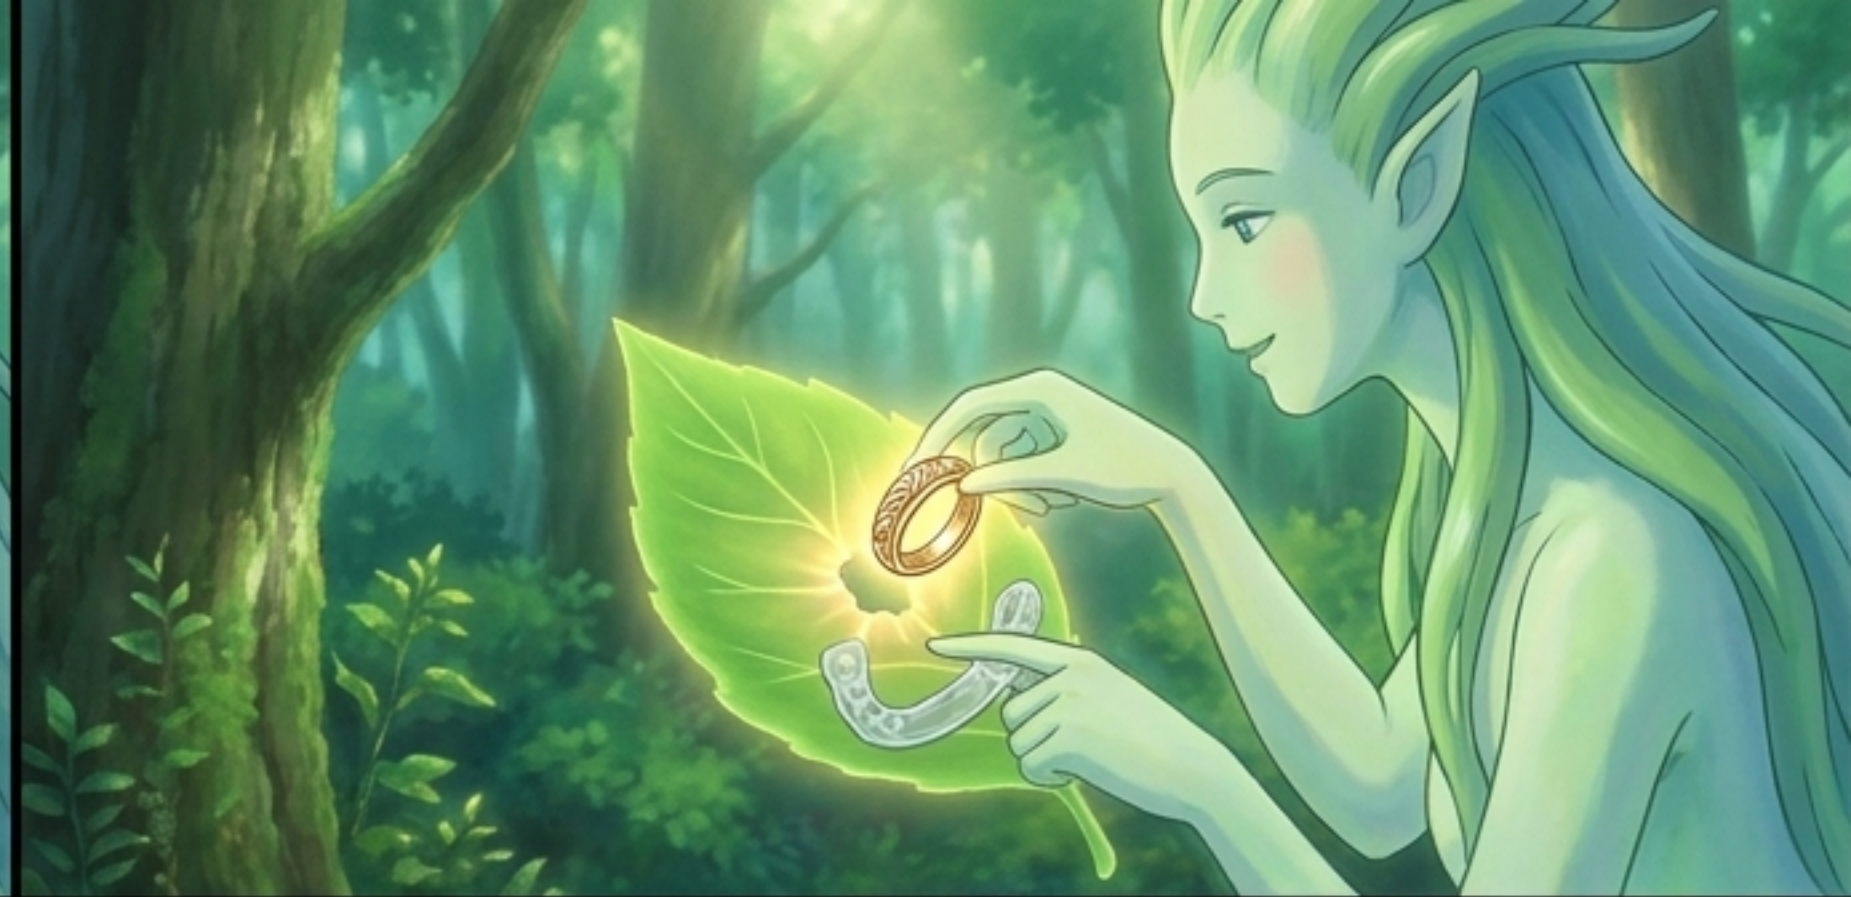

Clear plastic retainers are generally unsuitable for the highly active initial healing phase of a fresh wound.
Nature rejects a hasty substitute.