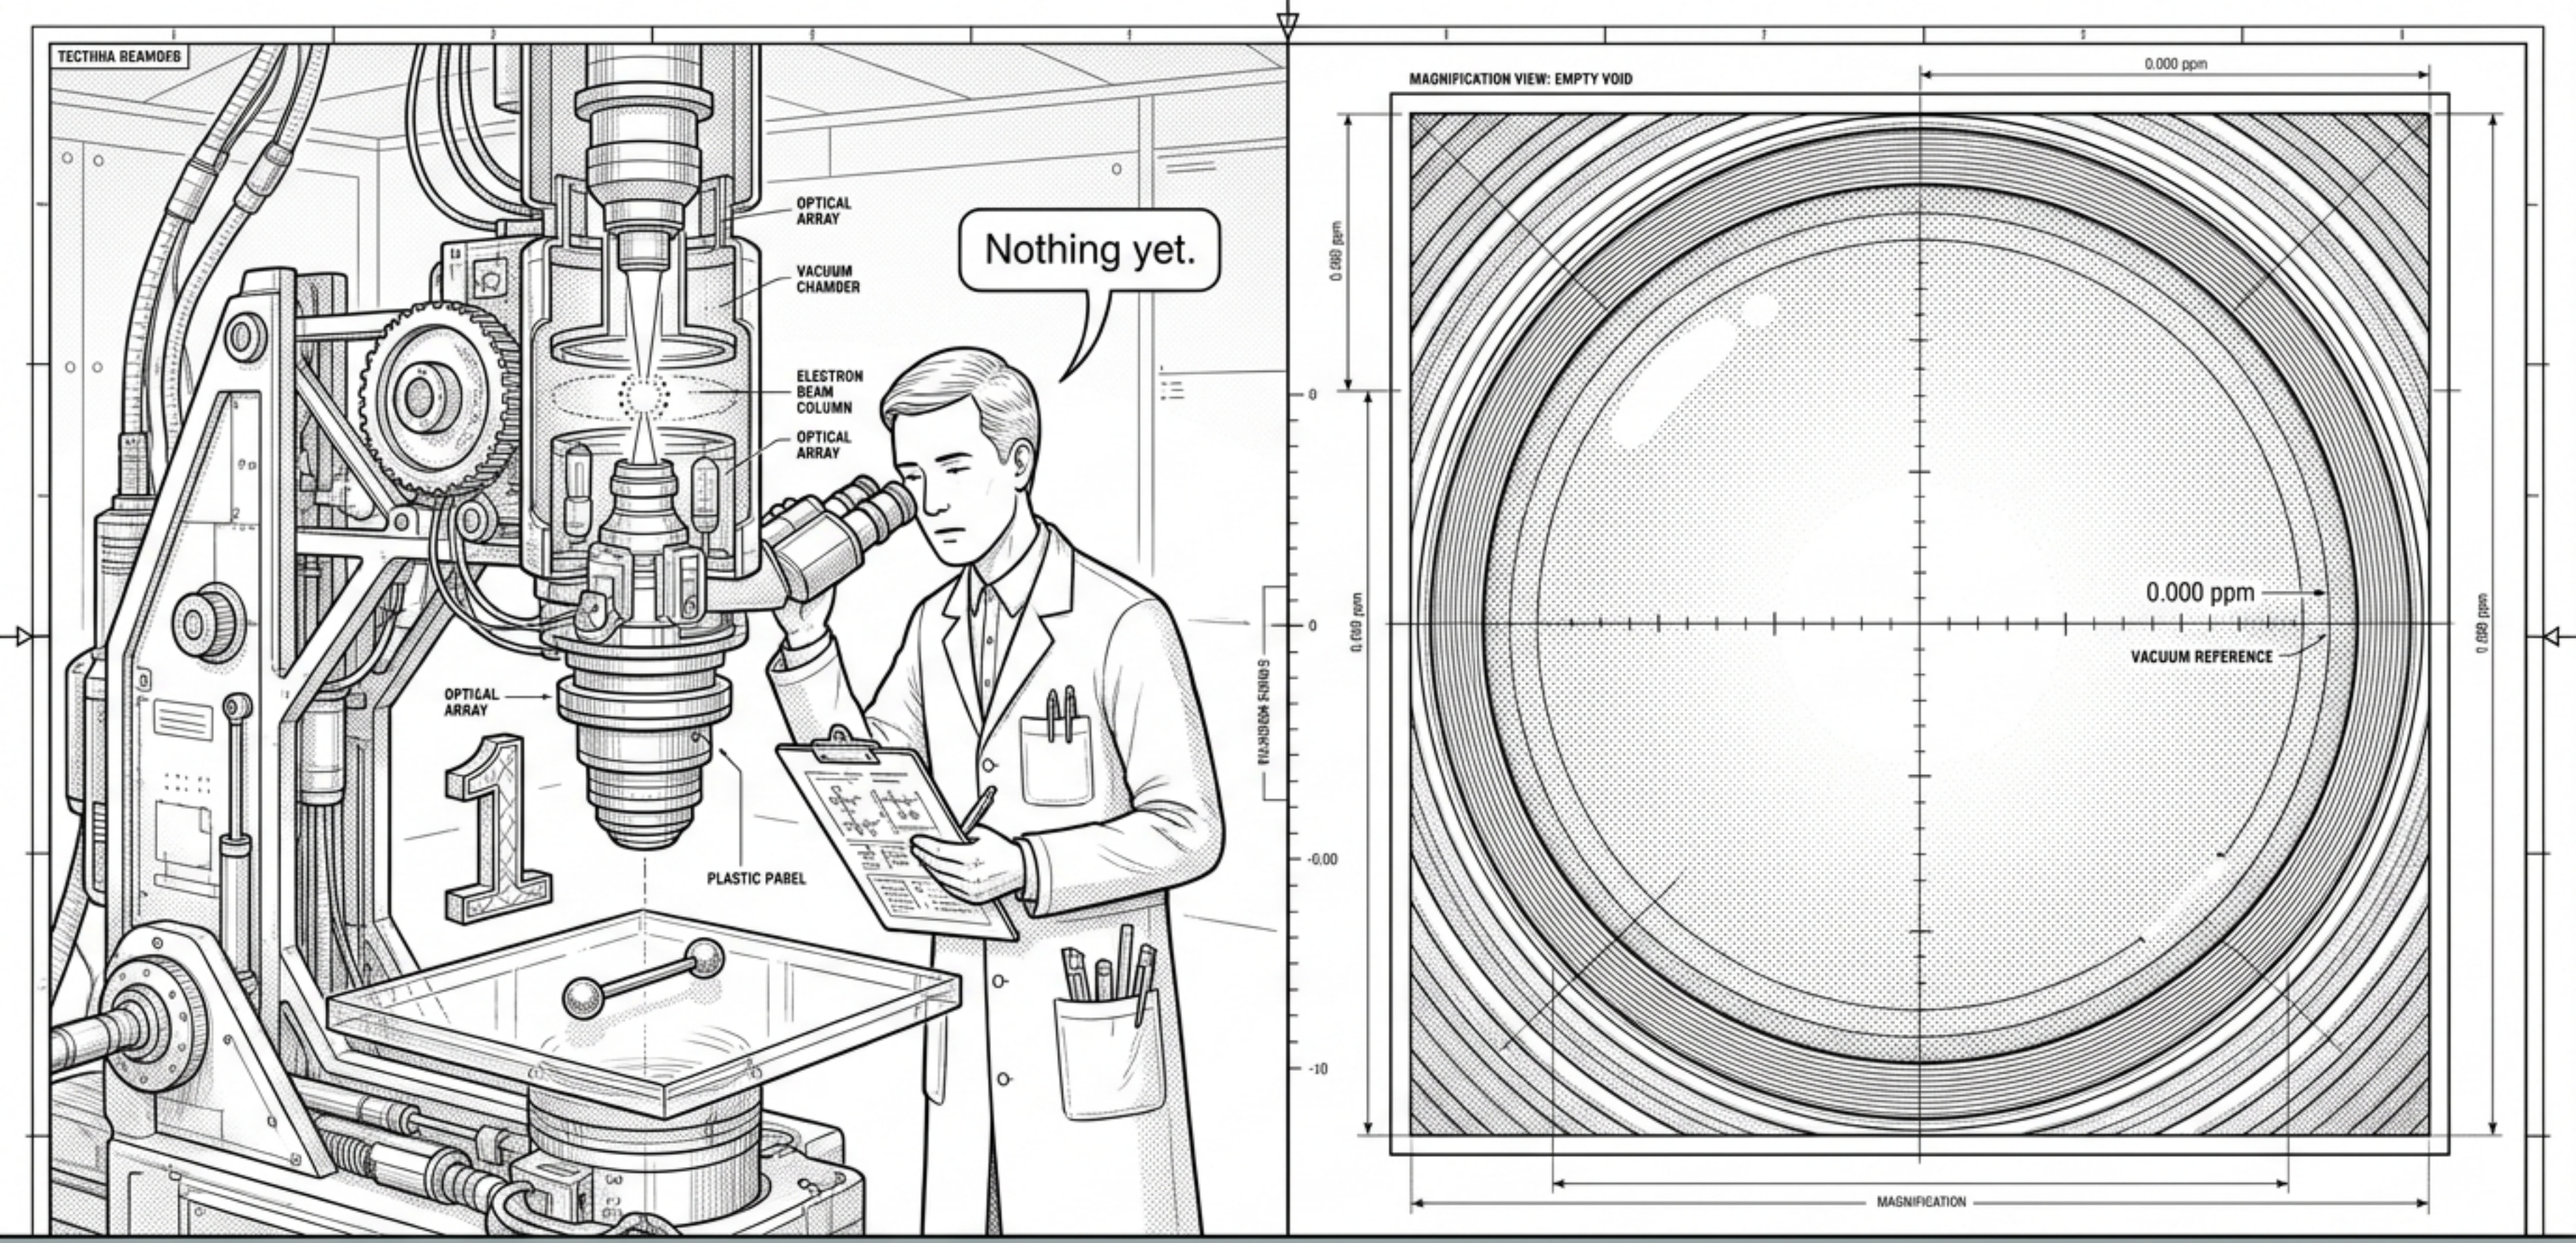


BioFlex phthalate traces measure below 1 ppm.

Almost as rare as a client who actually reads the aftercare instructions.