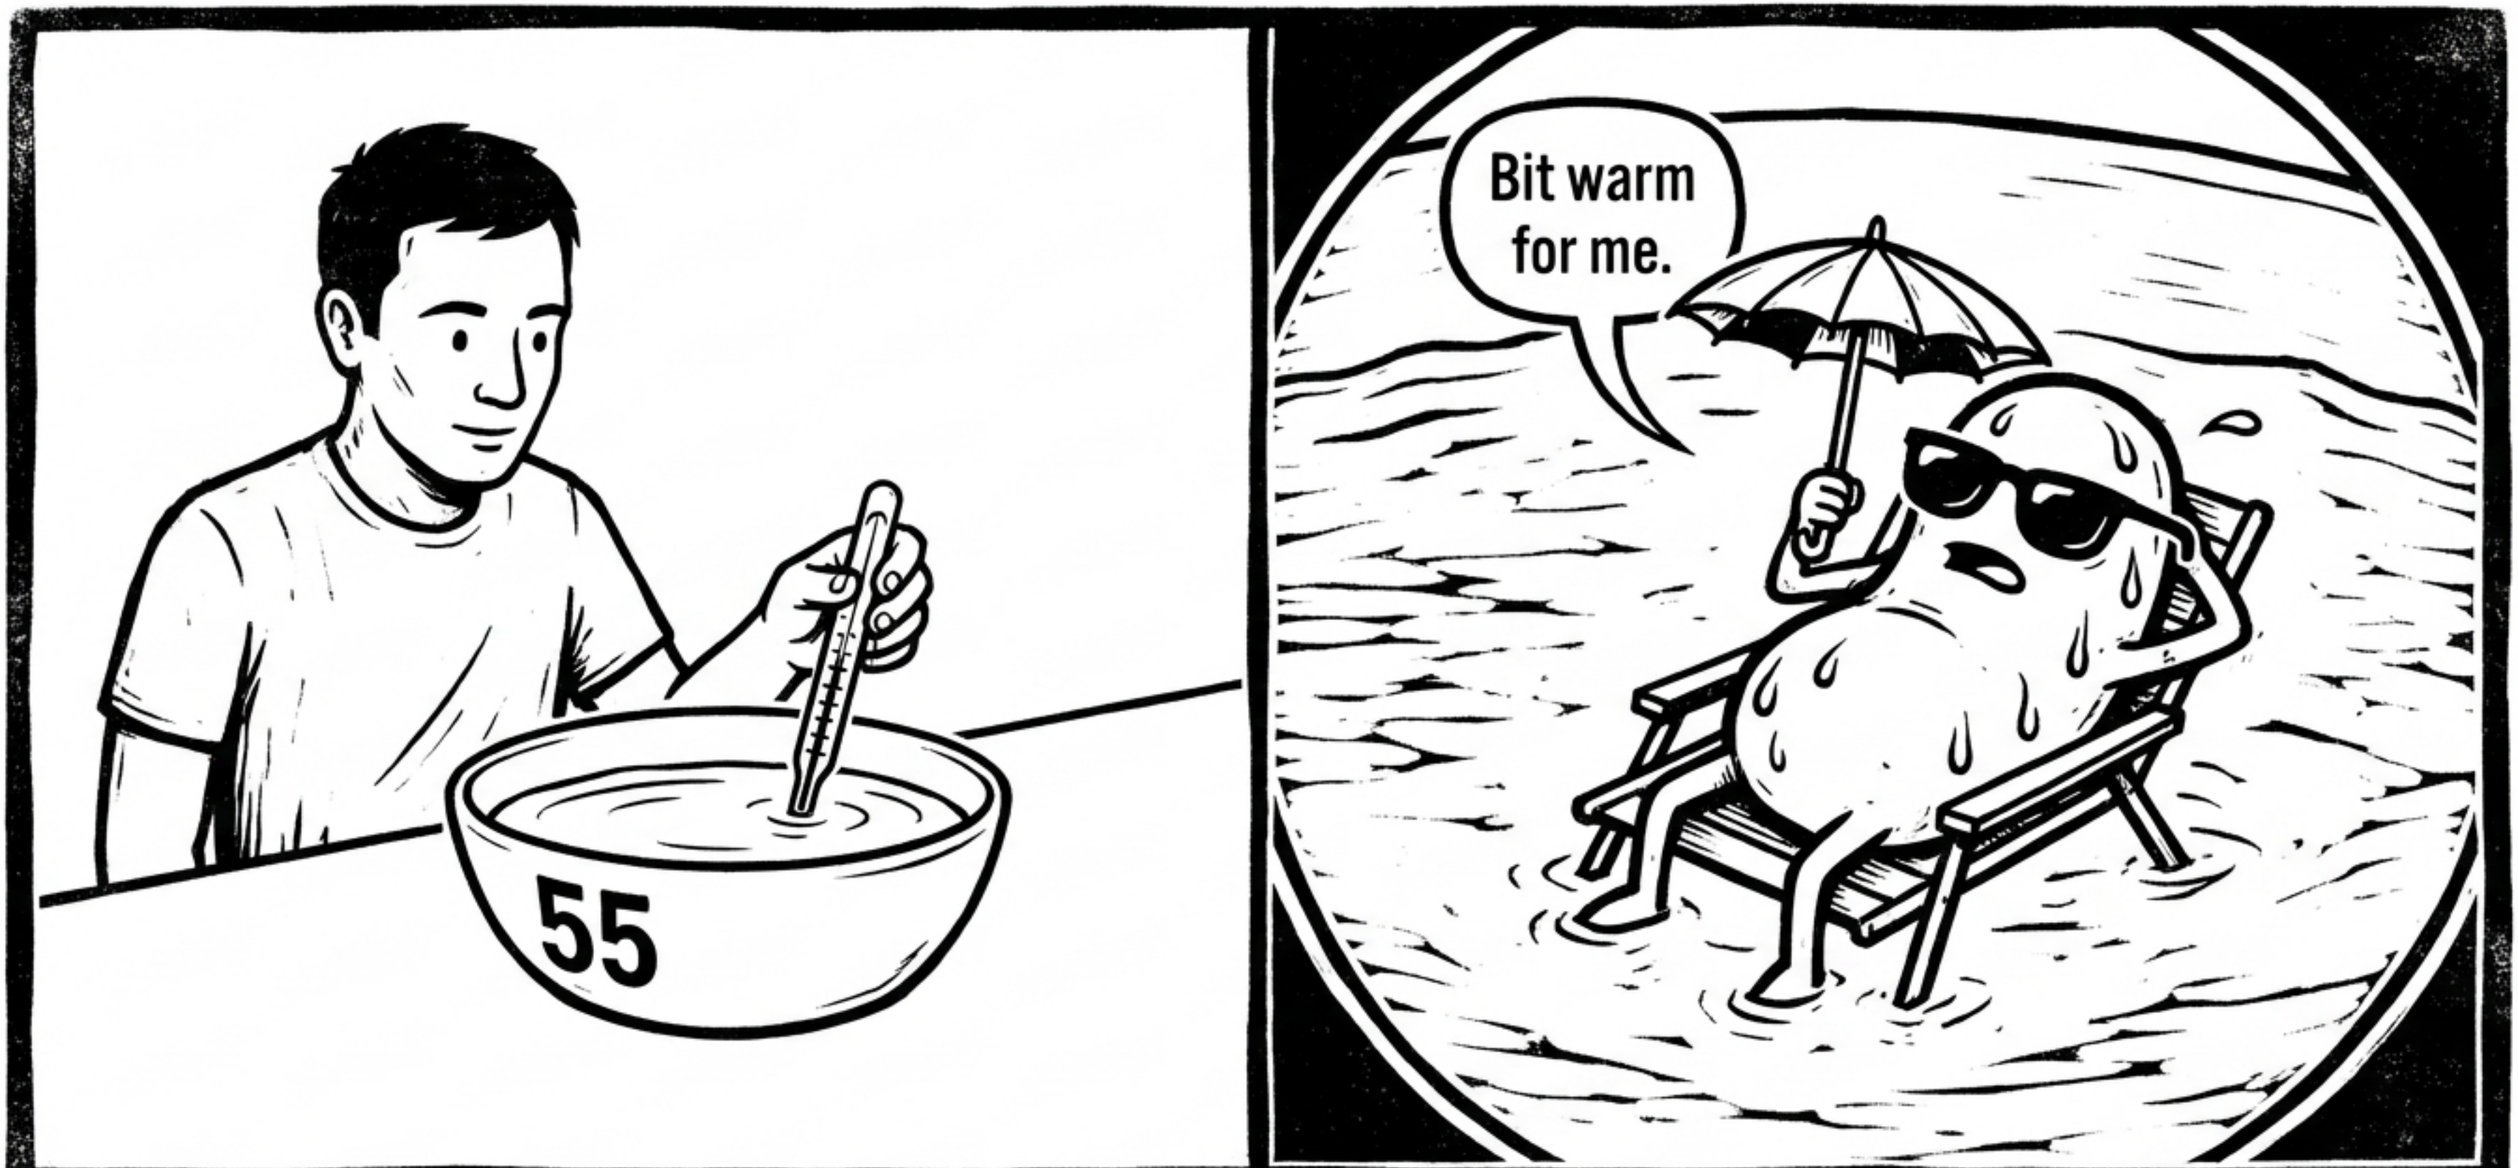

Reusable tattoo instruments should be cleaned in water kept below 55°C so the enzymes don't degrade. The microscopic cleaning crew prefers a mild autumn climate for optimal productivity.

Gemini Notebook