



Single-gear drivetrain
specifications.

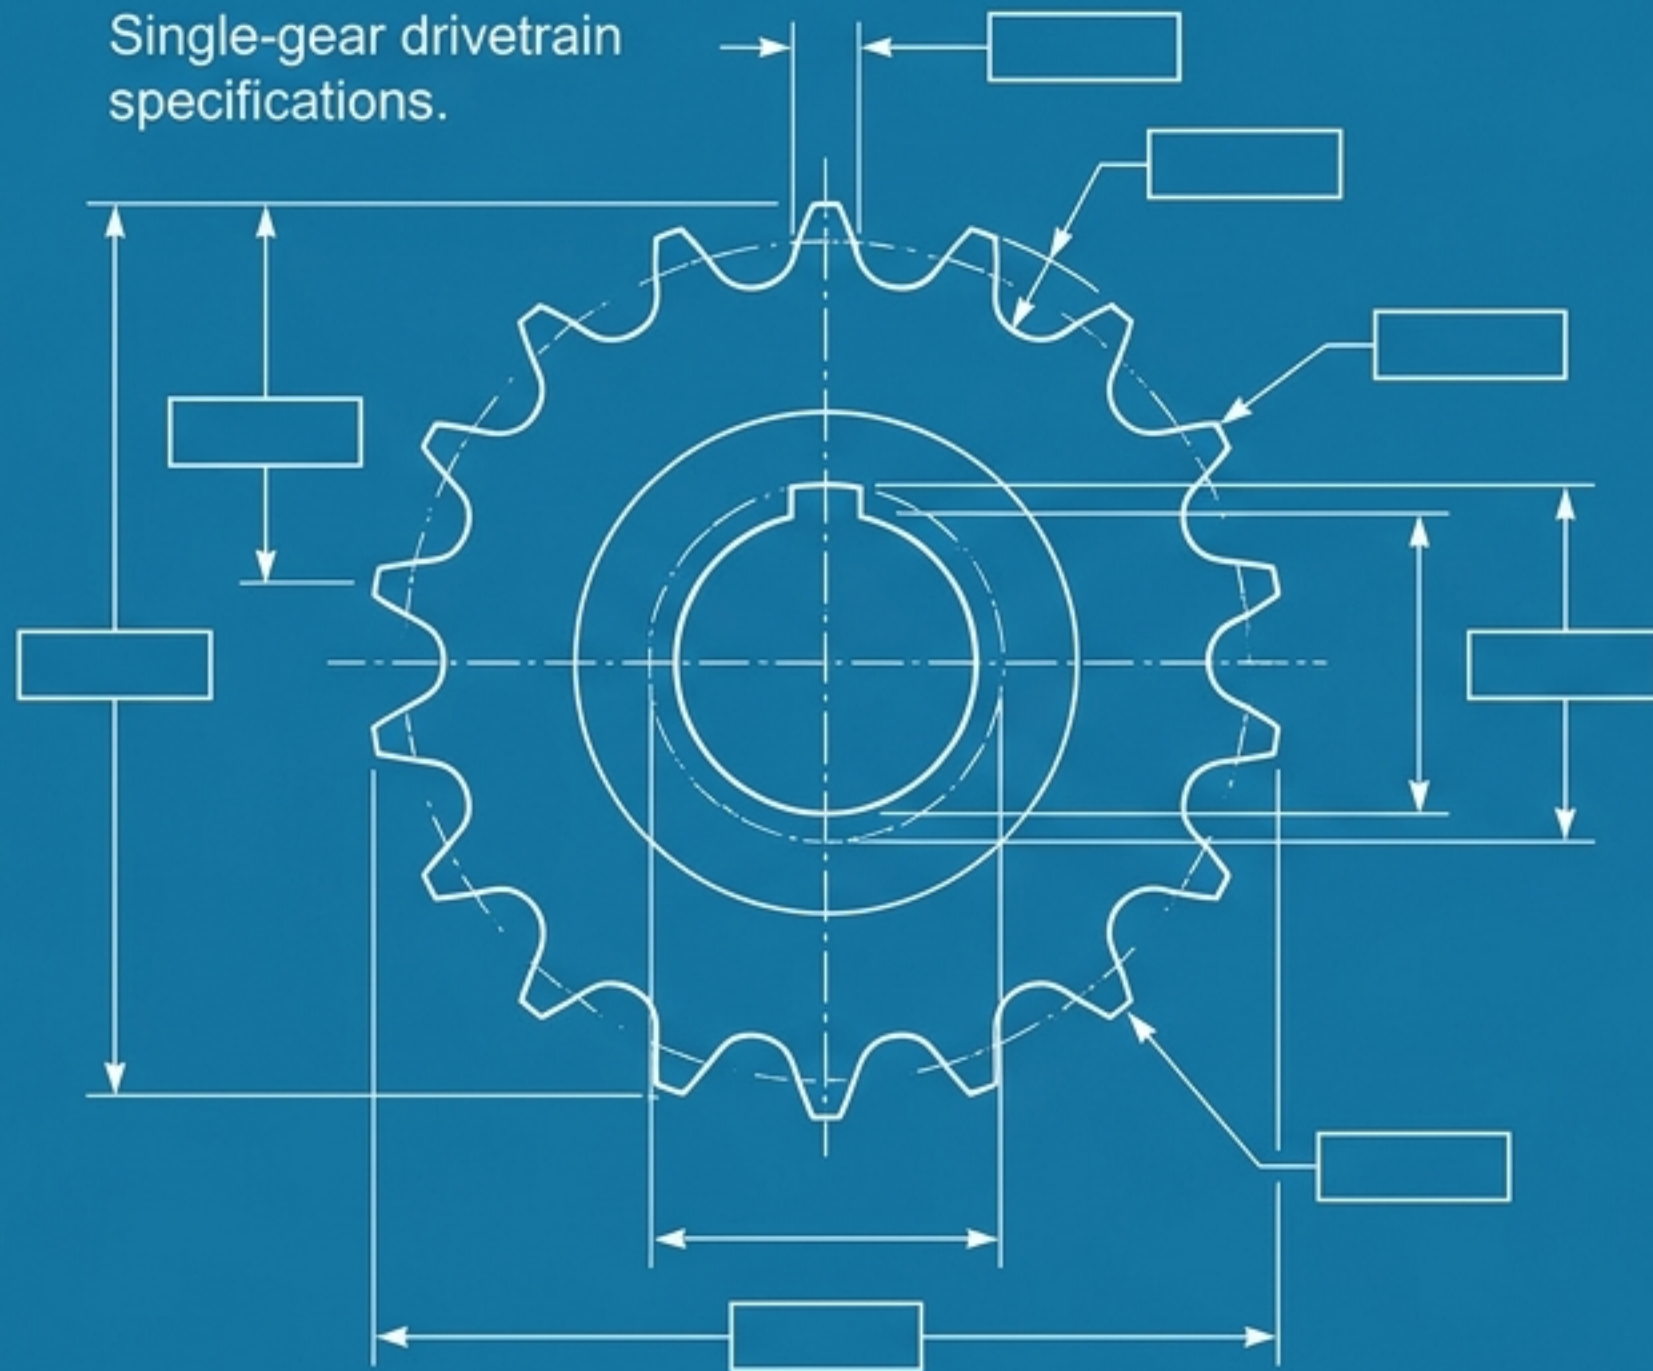

Sterile equipment
requirements.

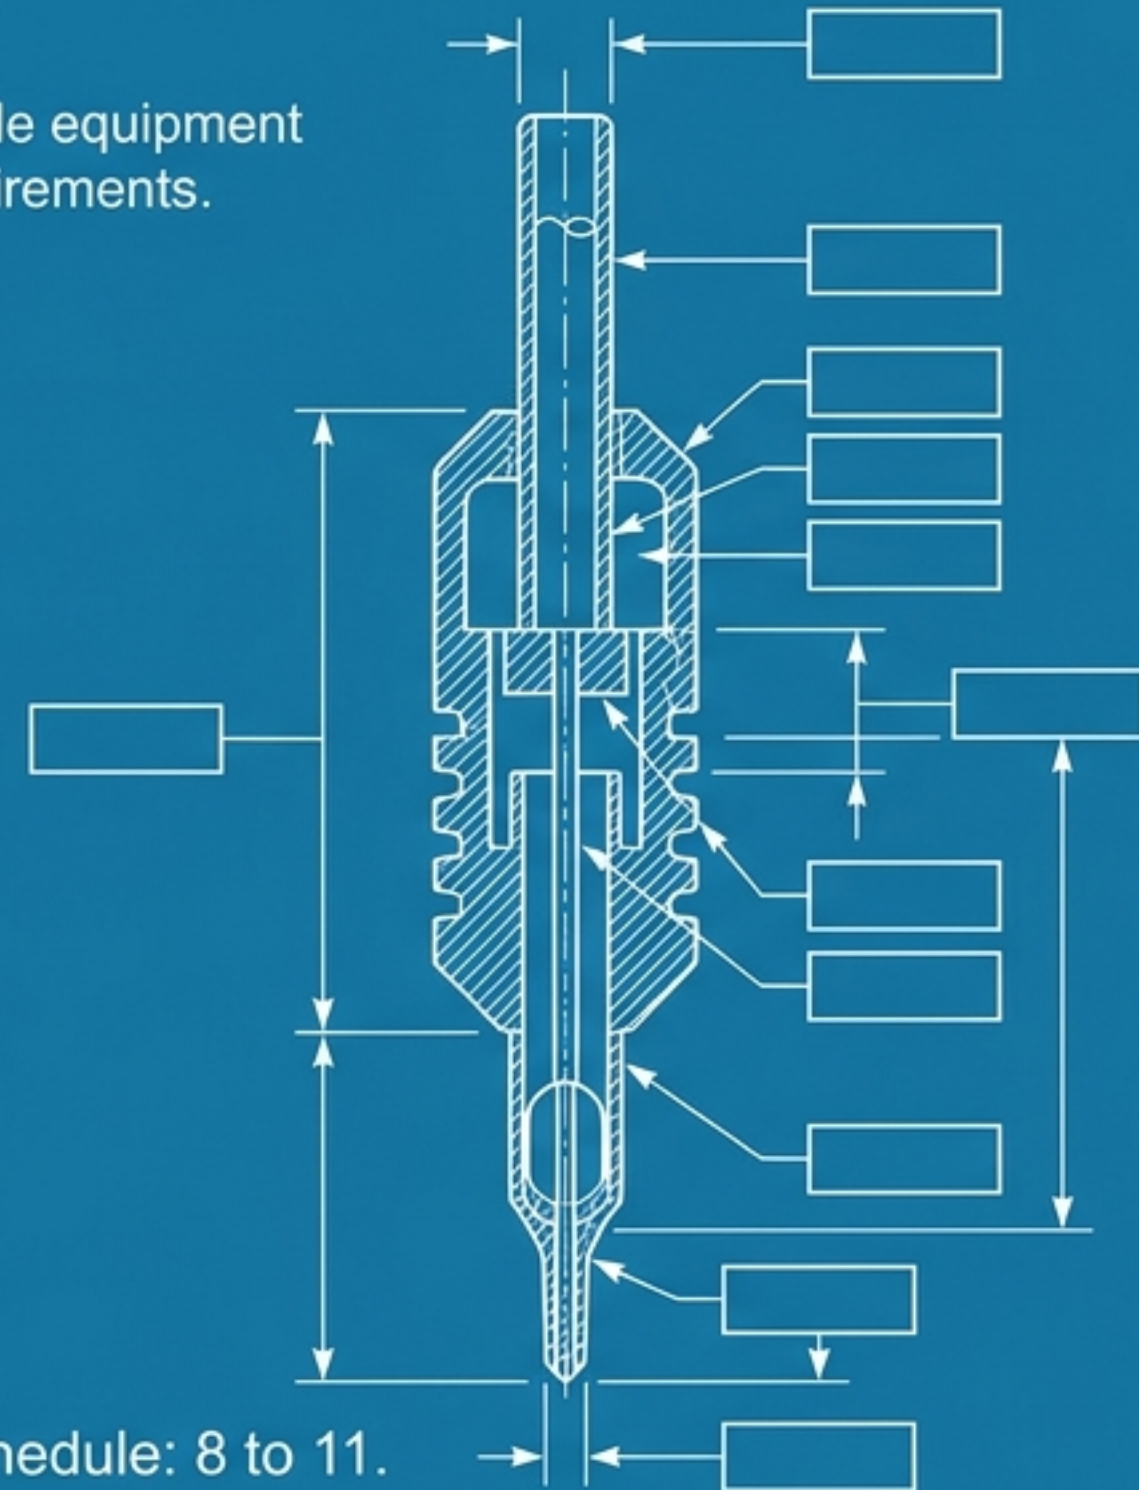

October schedule: 8 to 11.

Administered by a licensed professional artist using strictly sterile equipment.

ON-SITE STERILE ADMINISTRATION