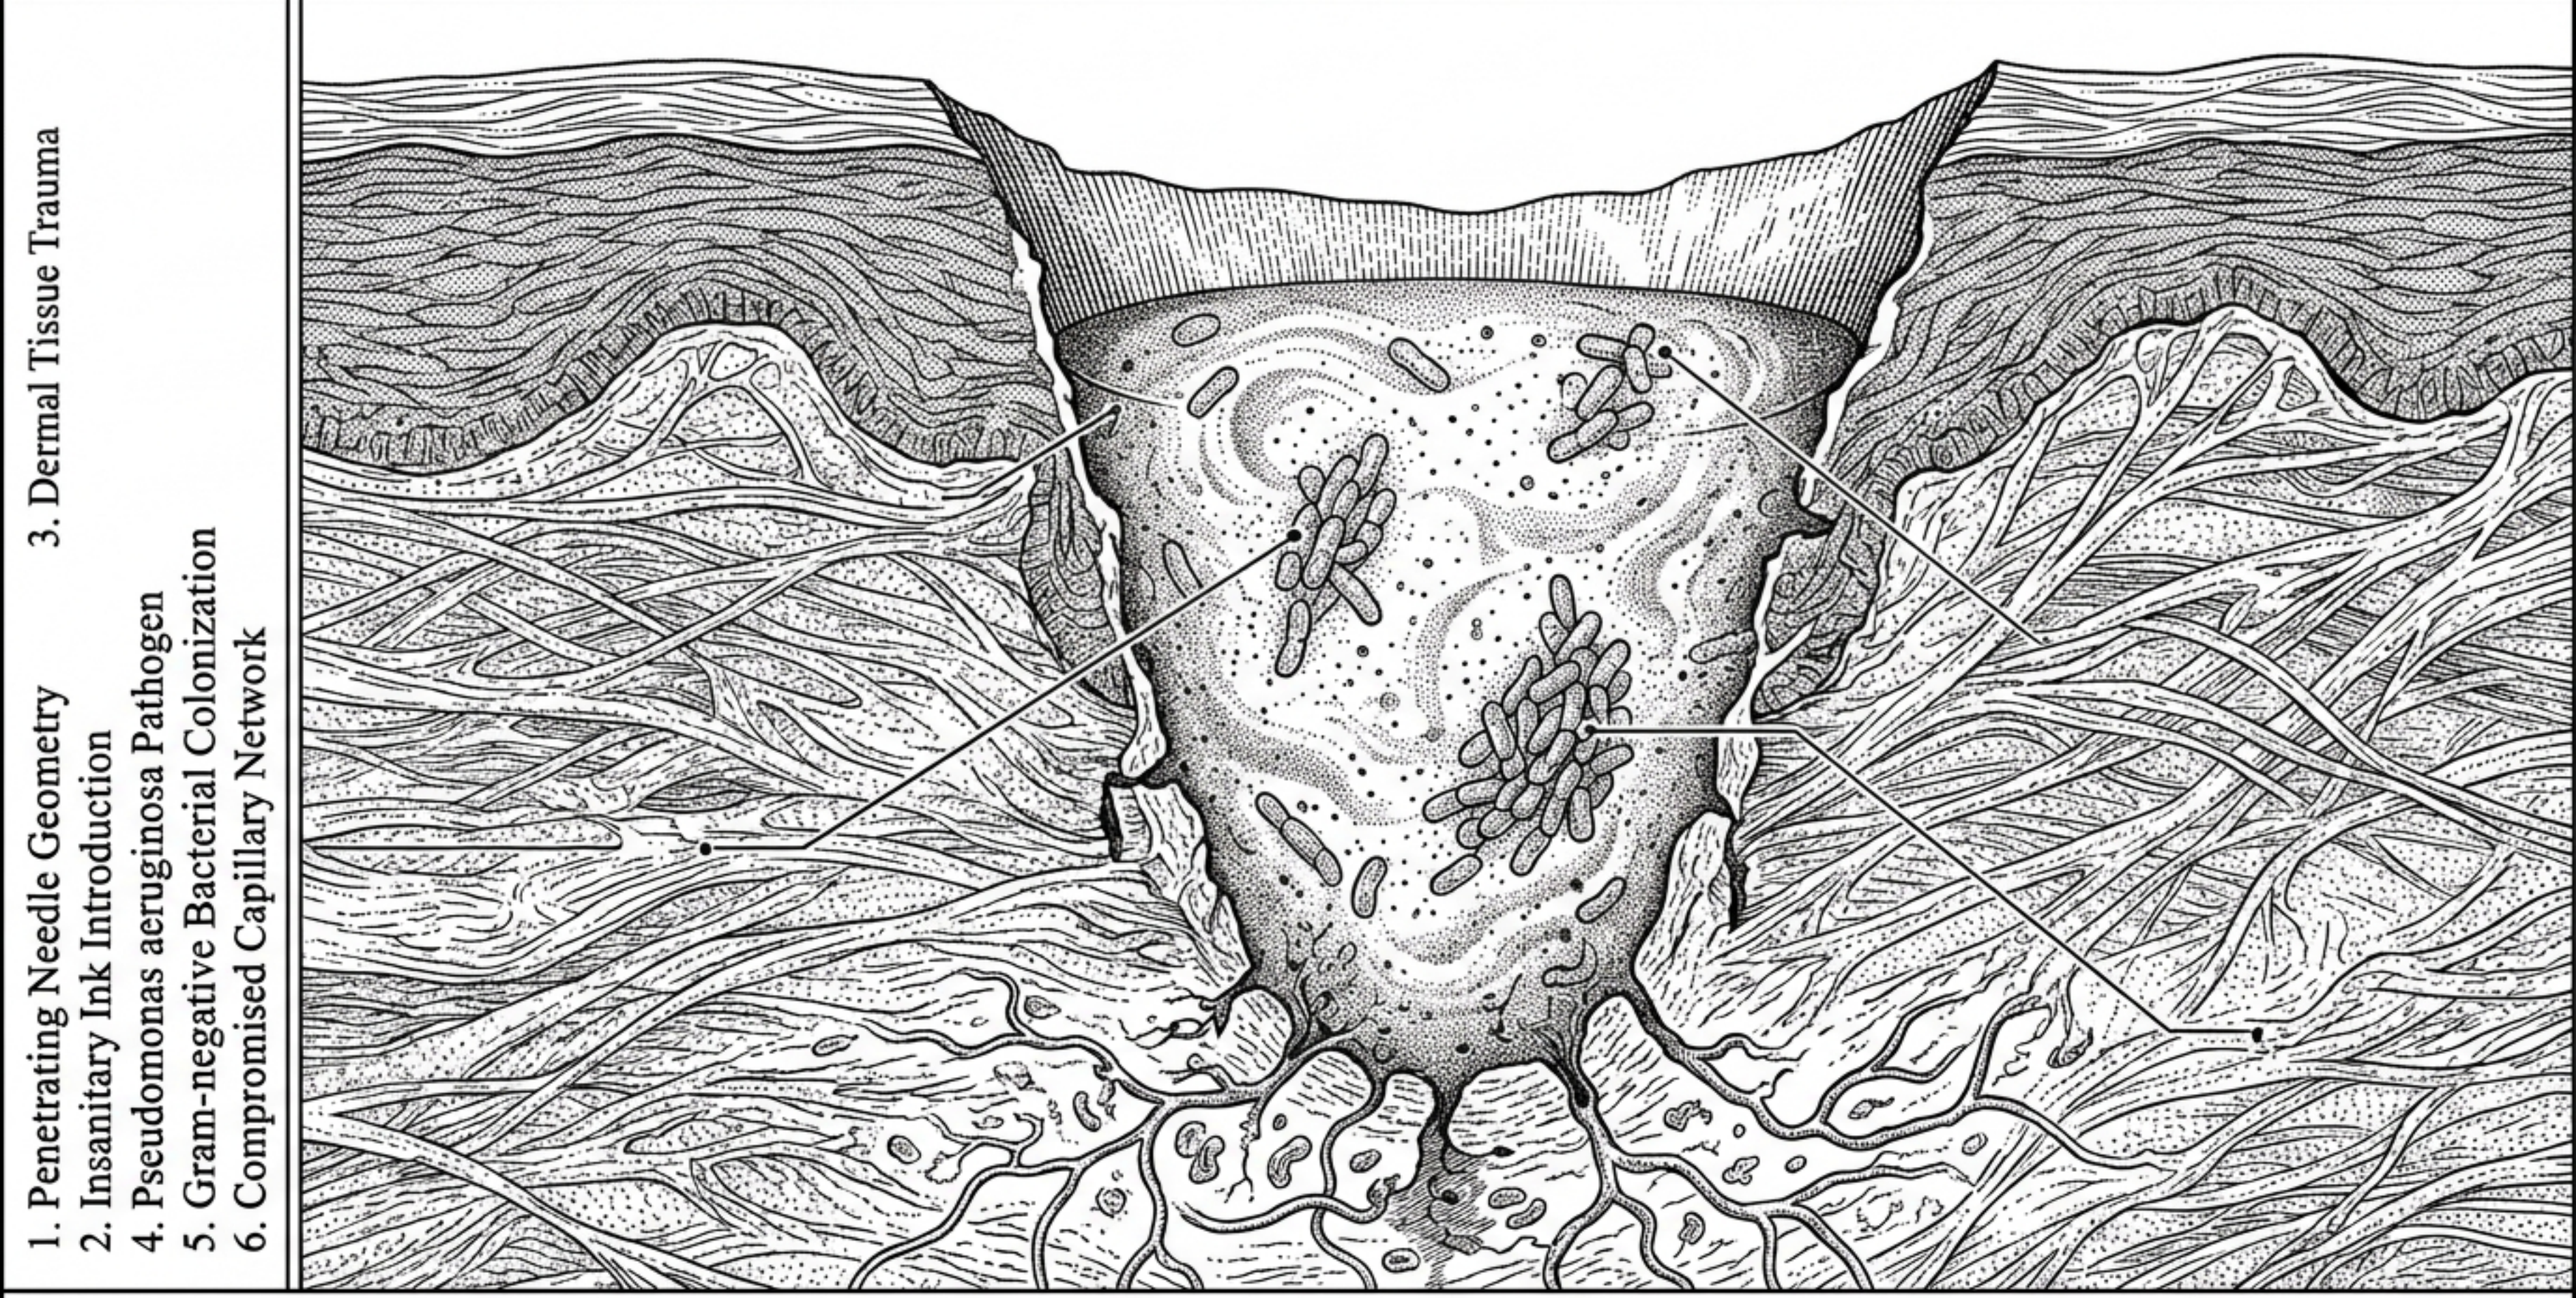

FDA testing confirmed severe pathogenic bacterial contamination inside thirty percent of unopened, sealed inks.
STERILE BOTTLES REQUIRE VALIDATED MANUFACTURING.