

A




B



C



D

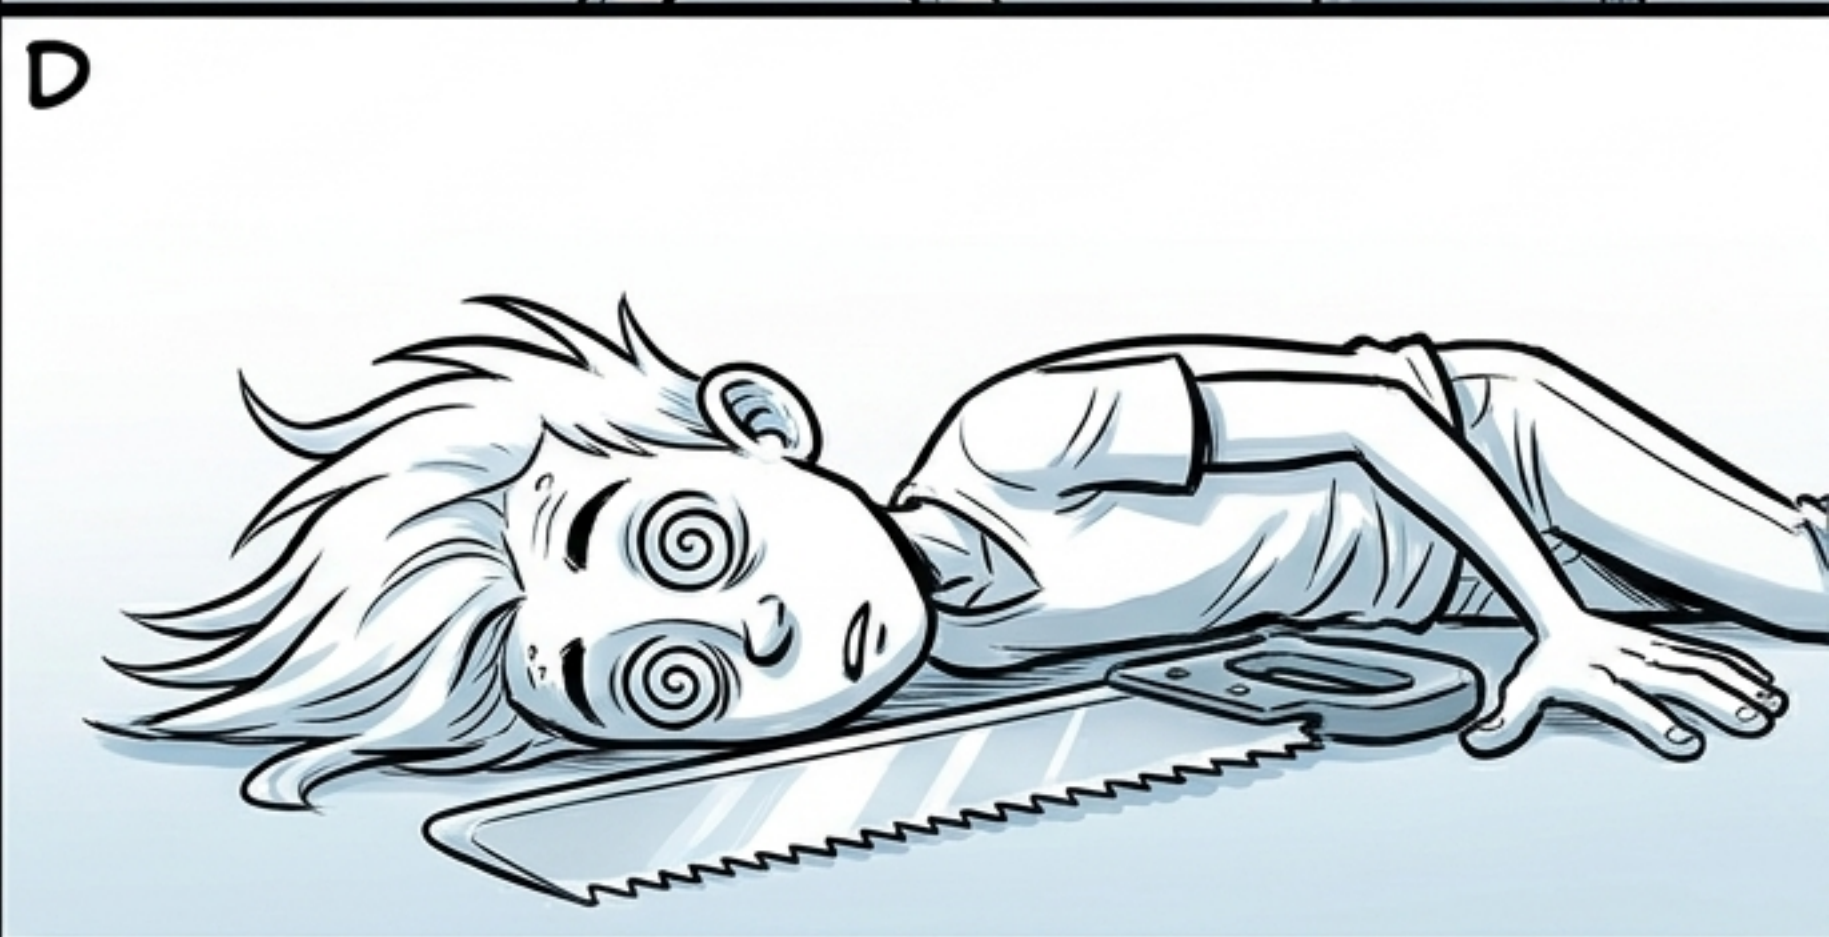

The label surgical steel does not guarantee that finished jewelry meets a safe nickel-release threshold. Medical cutlery makes for an incredibly heavy accessory.