


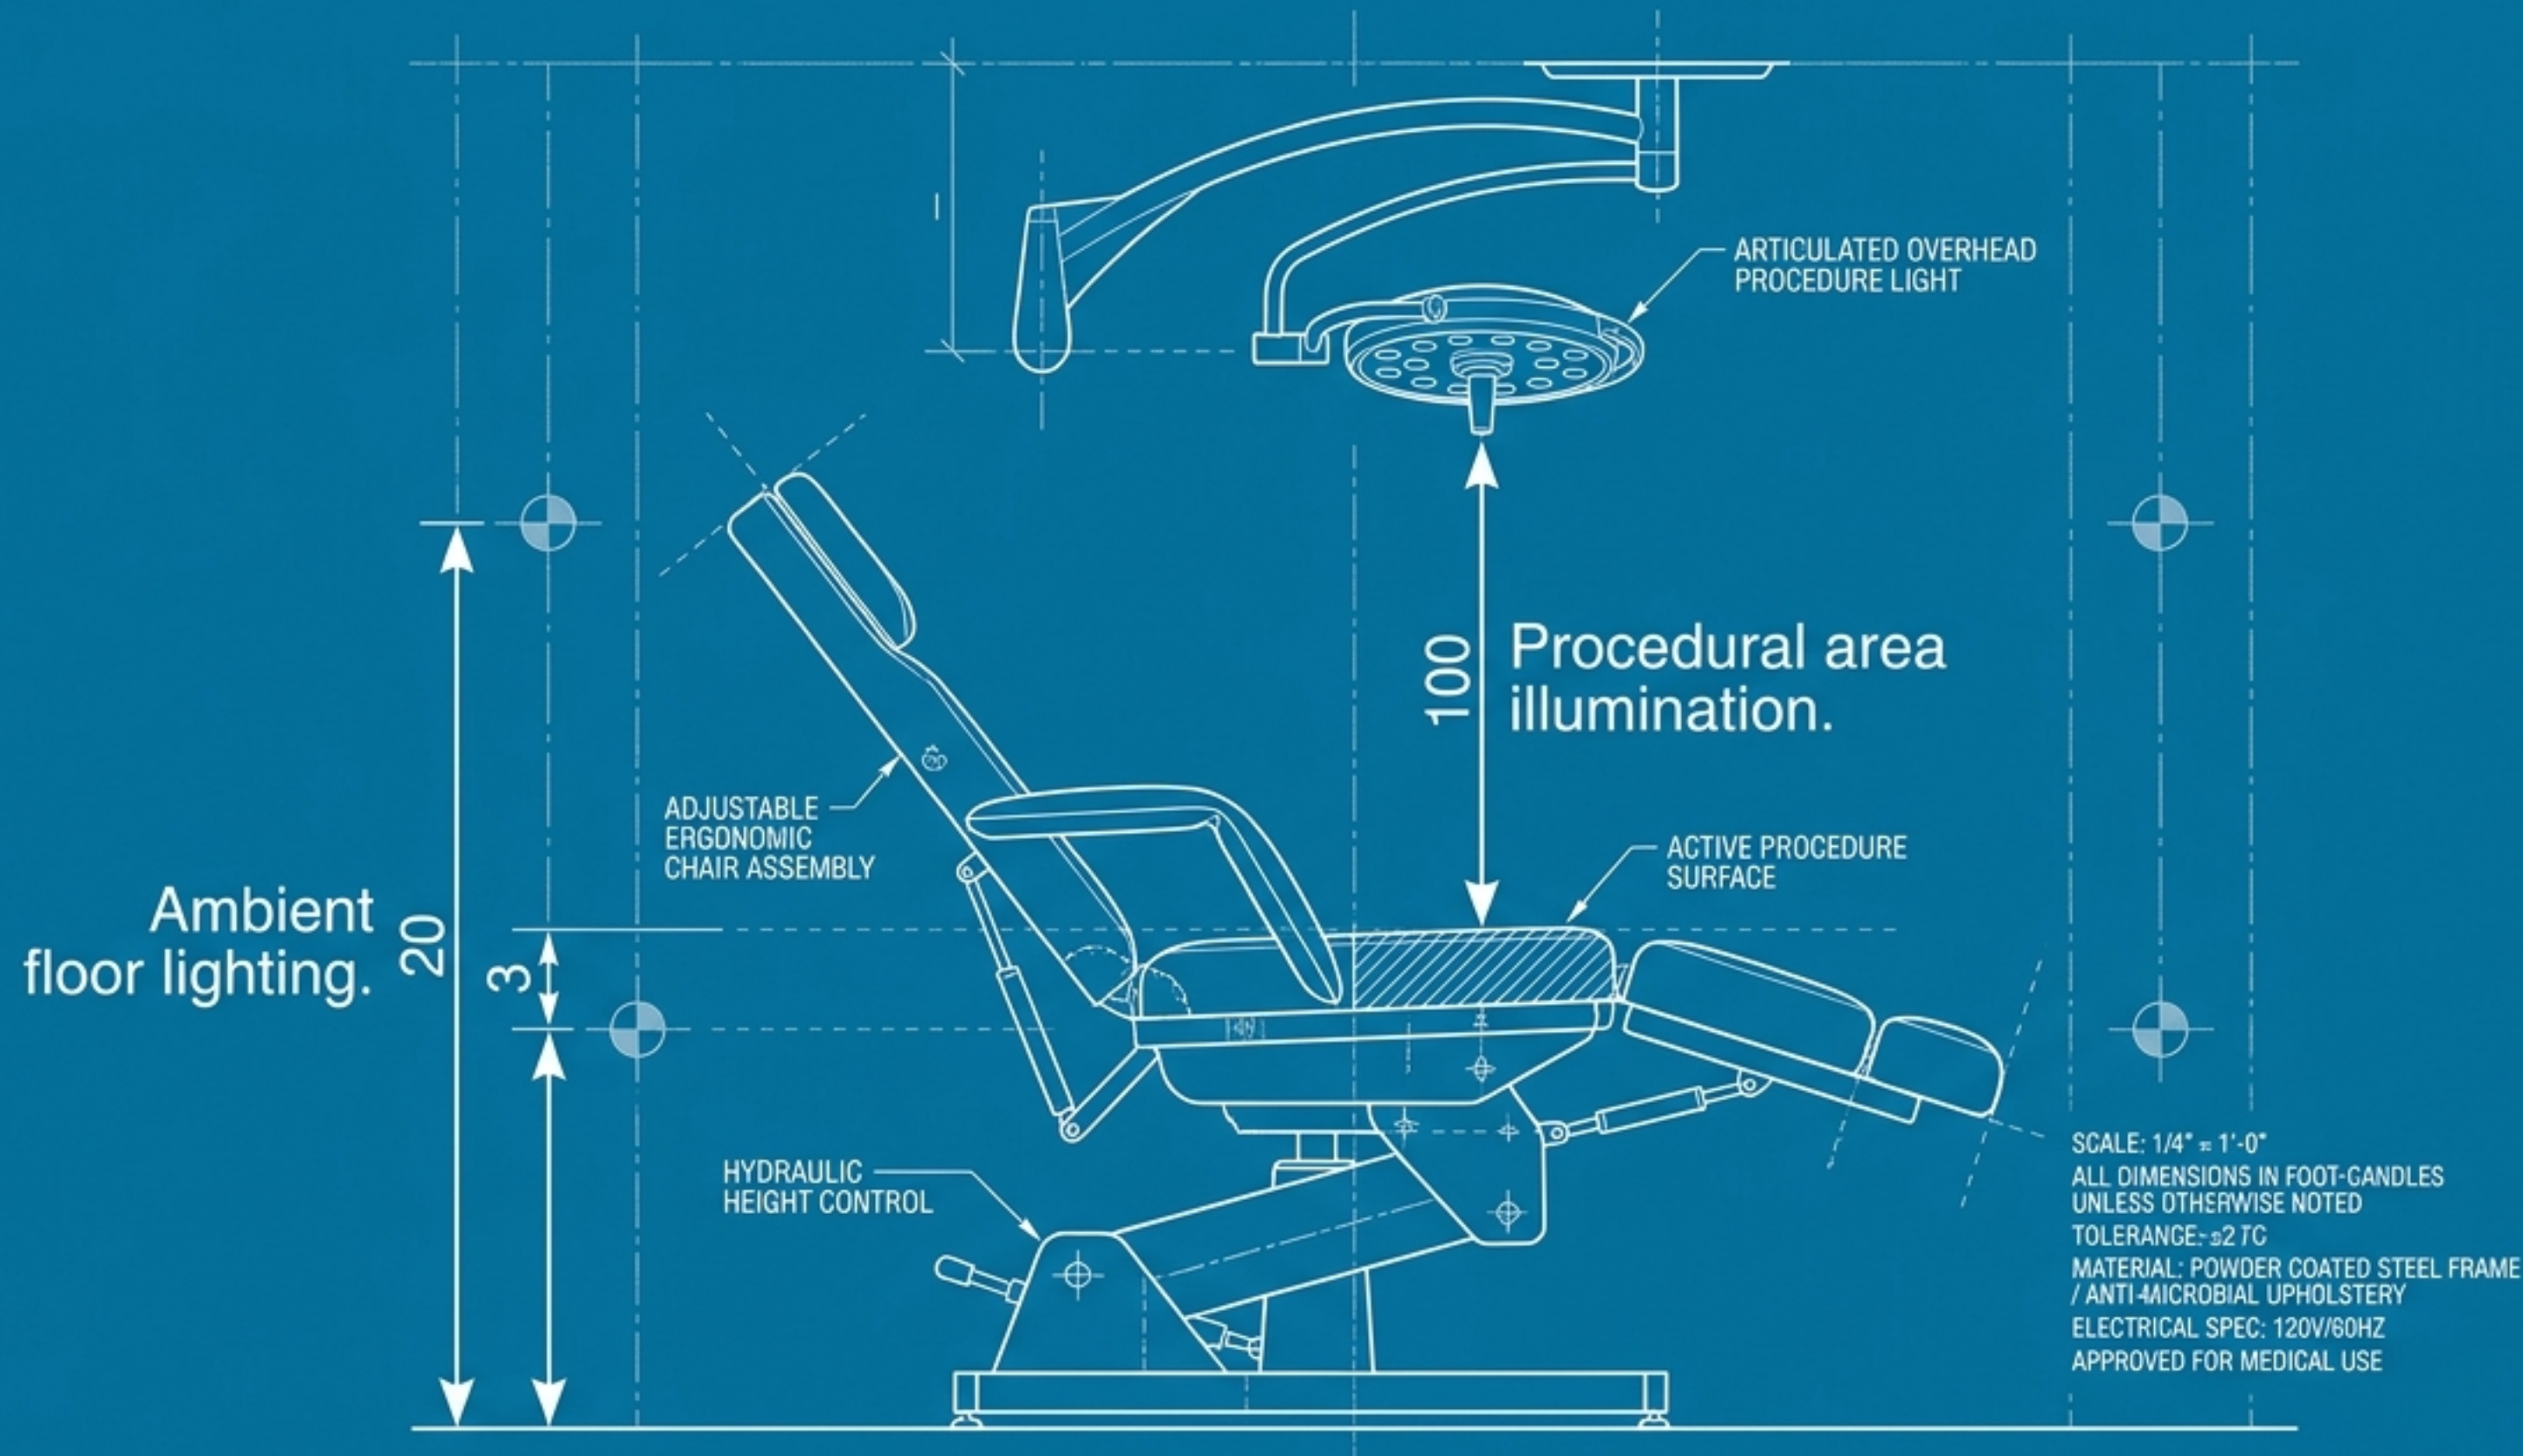

General studio areas require twenty foot-candles at three feet height.
MAINTAIN ONE HUNDRED FOOT-CANDLES AT PROCEDURAL LEVEL.