


INITIAL JEWELRY REQUIRES
10 MILLIMETERS LENGTH.

SWELLING SUBSIDES LEAVING
A 2 MILLIMETER GAP.

SHORTEN TO 6 MILLIMETERS
FOR FLUSH FIT.

INTERNAL THREADS PROTECT
DELICATE TISSUE.

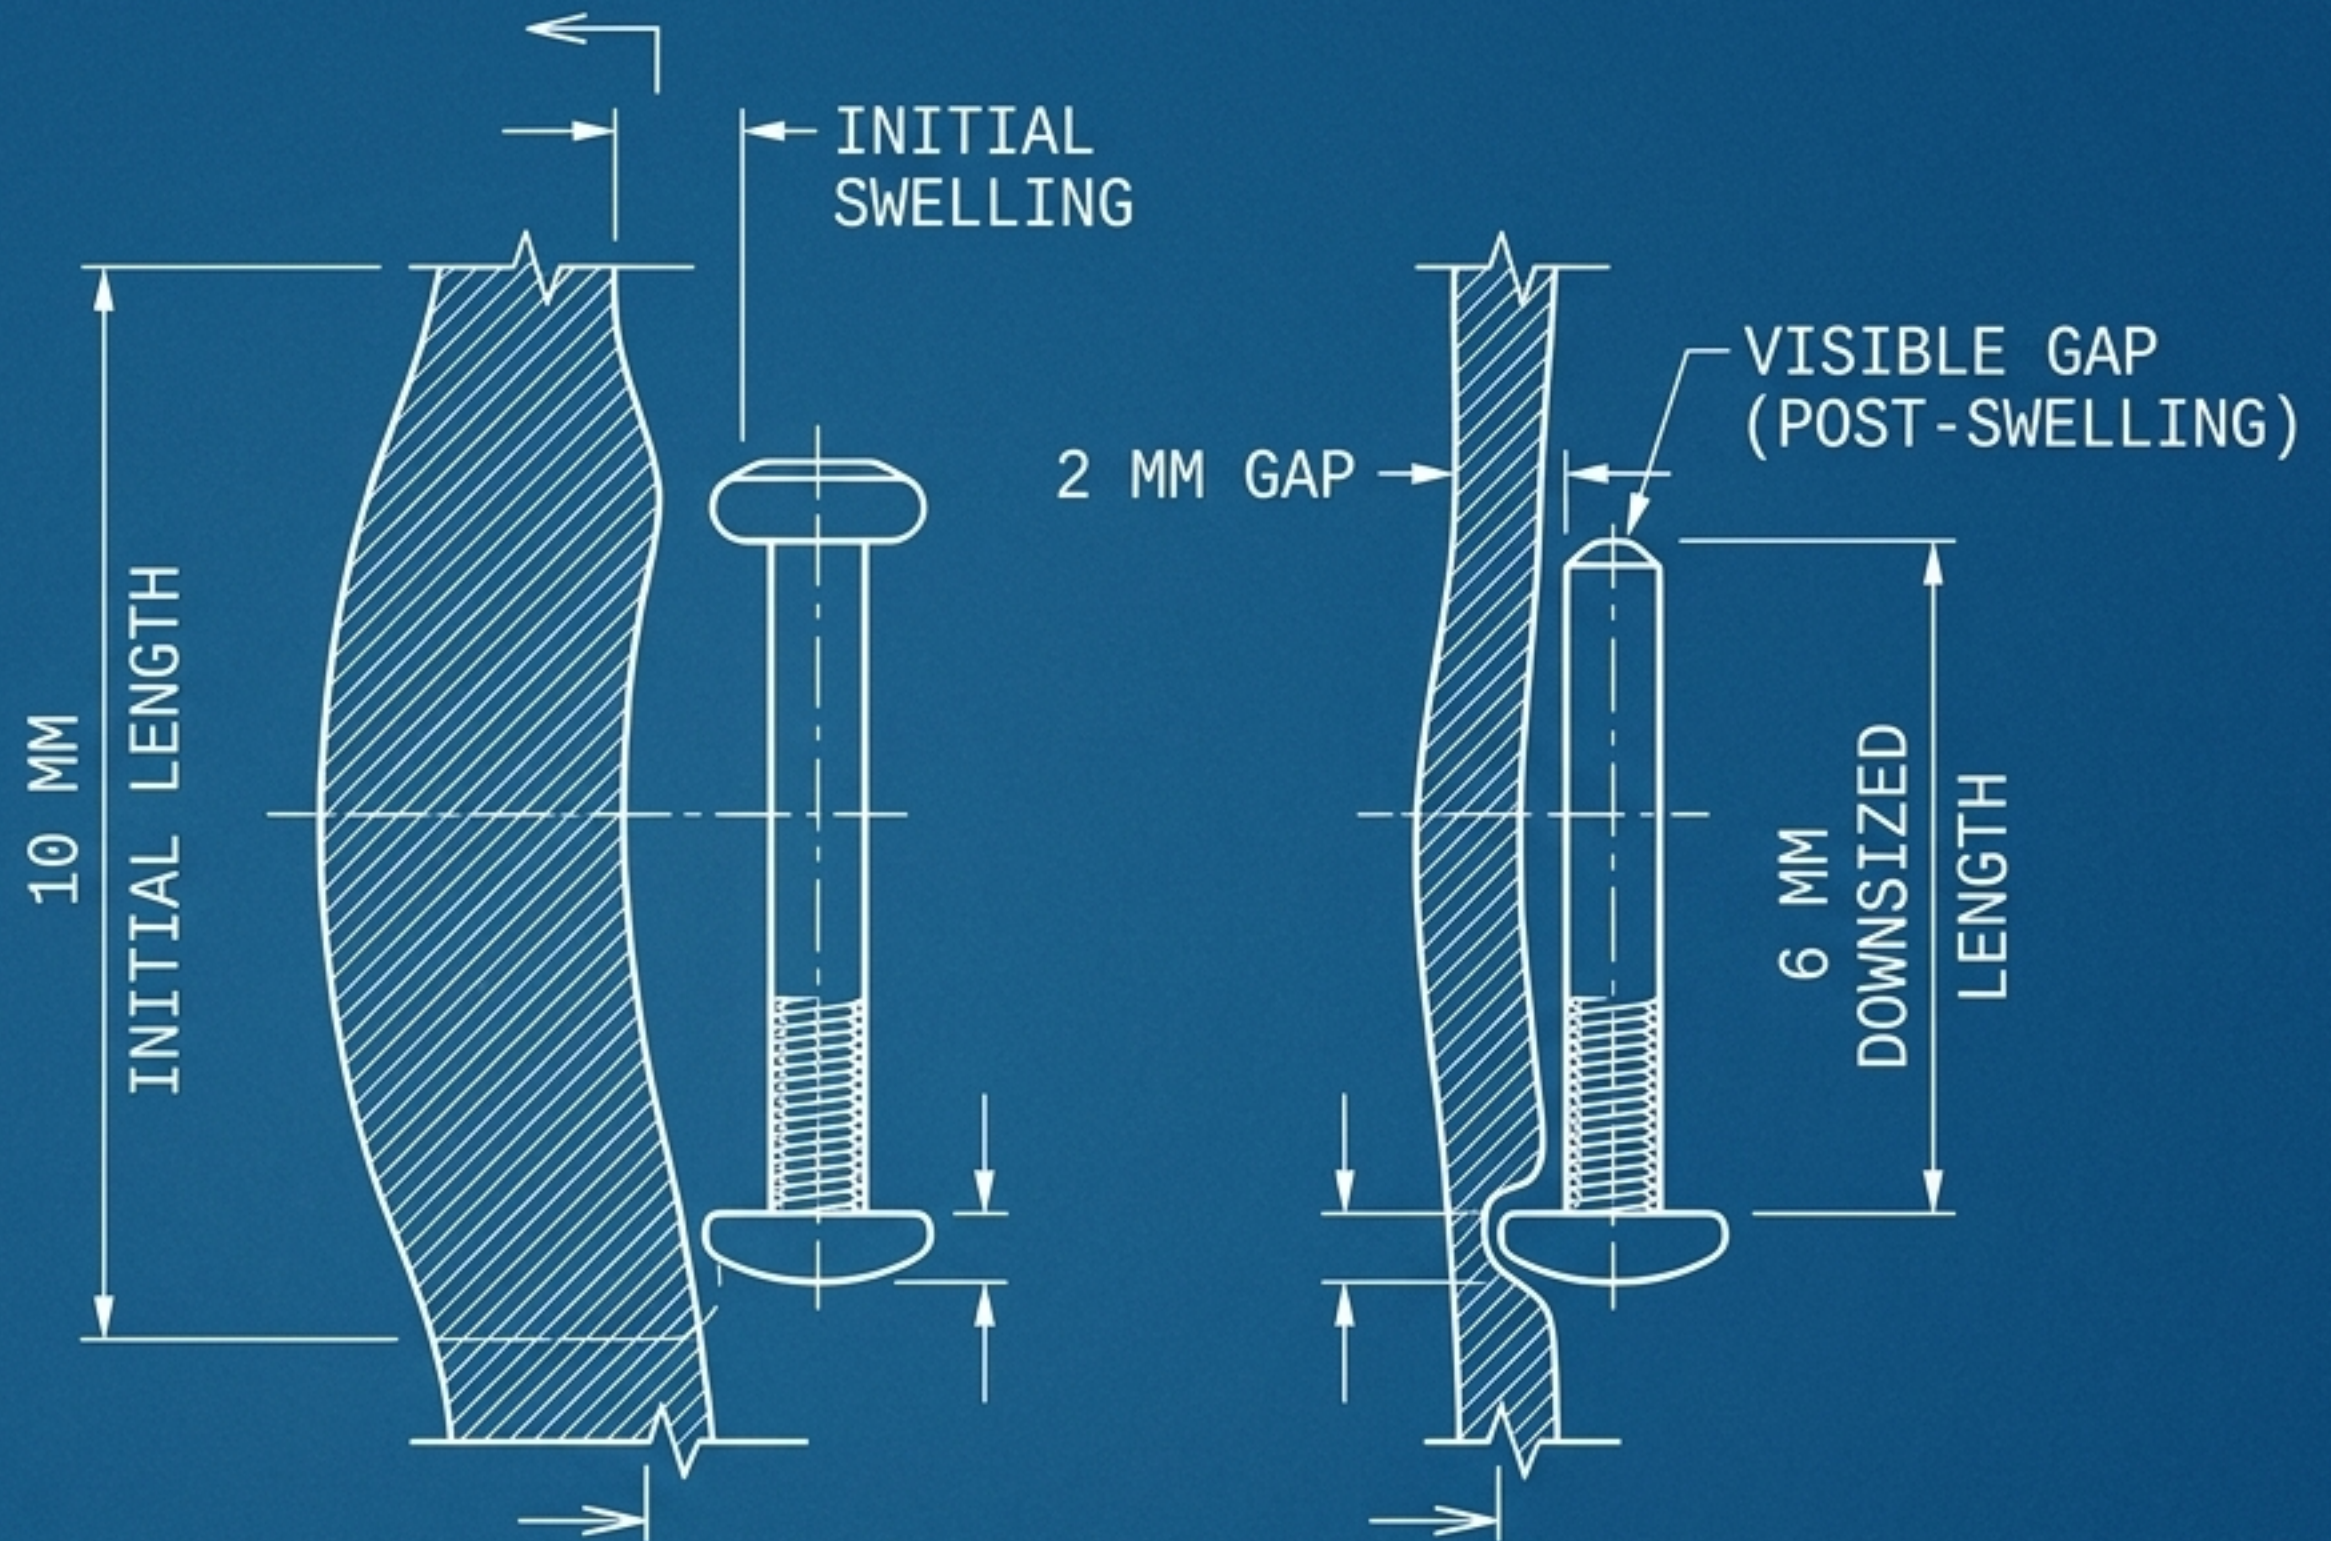

A VISIBLE GAP CONFIRMS INTERNAL SWELLING HAS RETREATED.

ALWAYS DOWNSIZE FOR STABILITY