DRAWING NO.	DATE:
BDA-JWL-001	REV. A

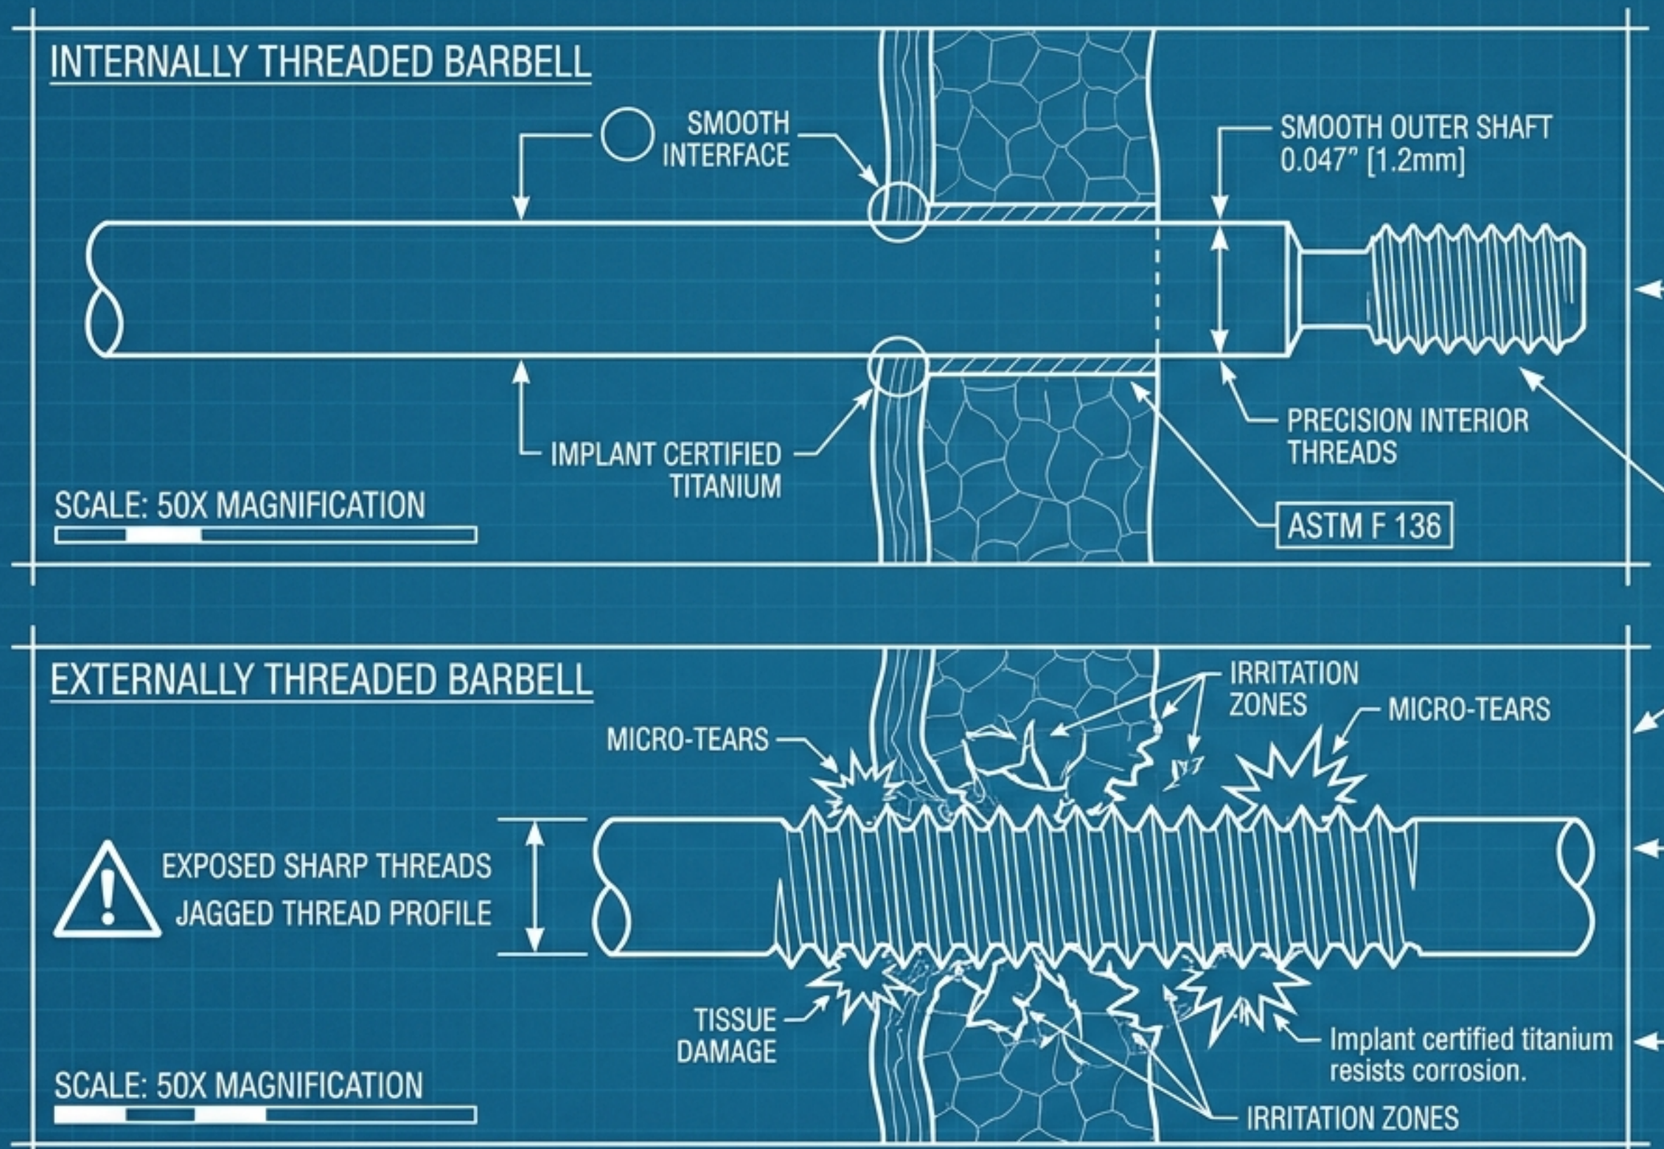

Internally threaded jewelry protects tissue.

Implant certified titanium resists corrosion.

External threads cause micro-tears.

ASTM F 136

DDA-00563

REP RR1325 2020Q1

SMOOTH JEWELRY SURFACES PREVENT SCAR TISSUE FORMATION DURING THE HEALING PROCESS.
CHOOSE INTERNAL THREADS.

DATE: OCT 26, 2023

DRAWING NO.	REV.
BDA-JWL-001	A