


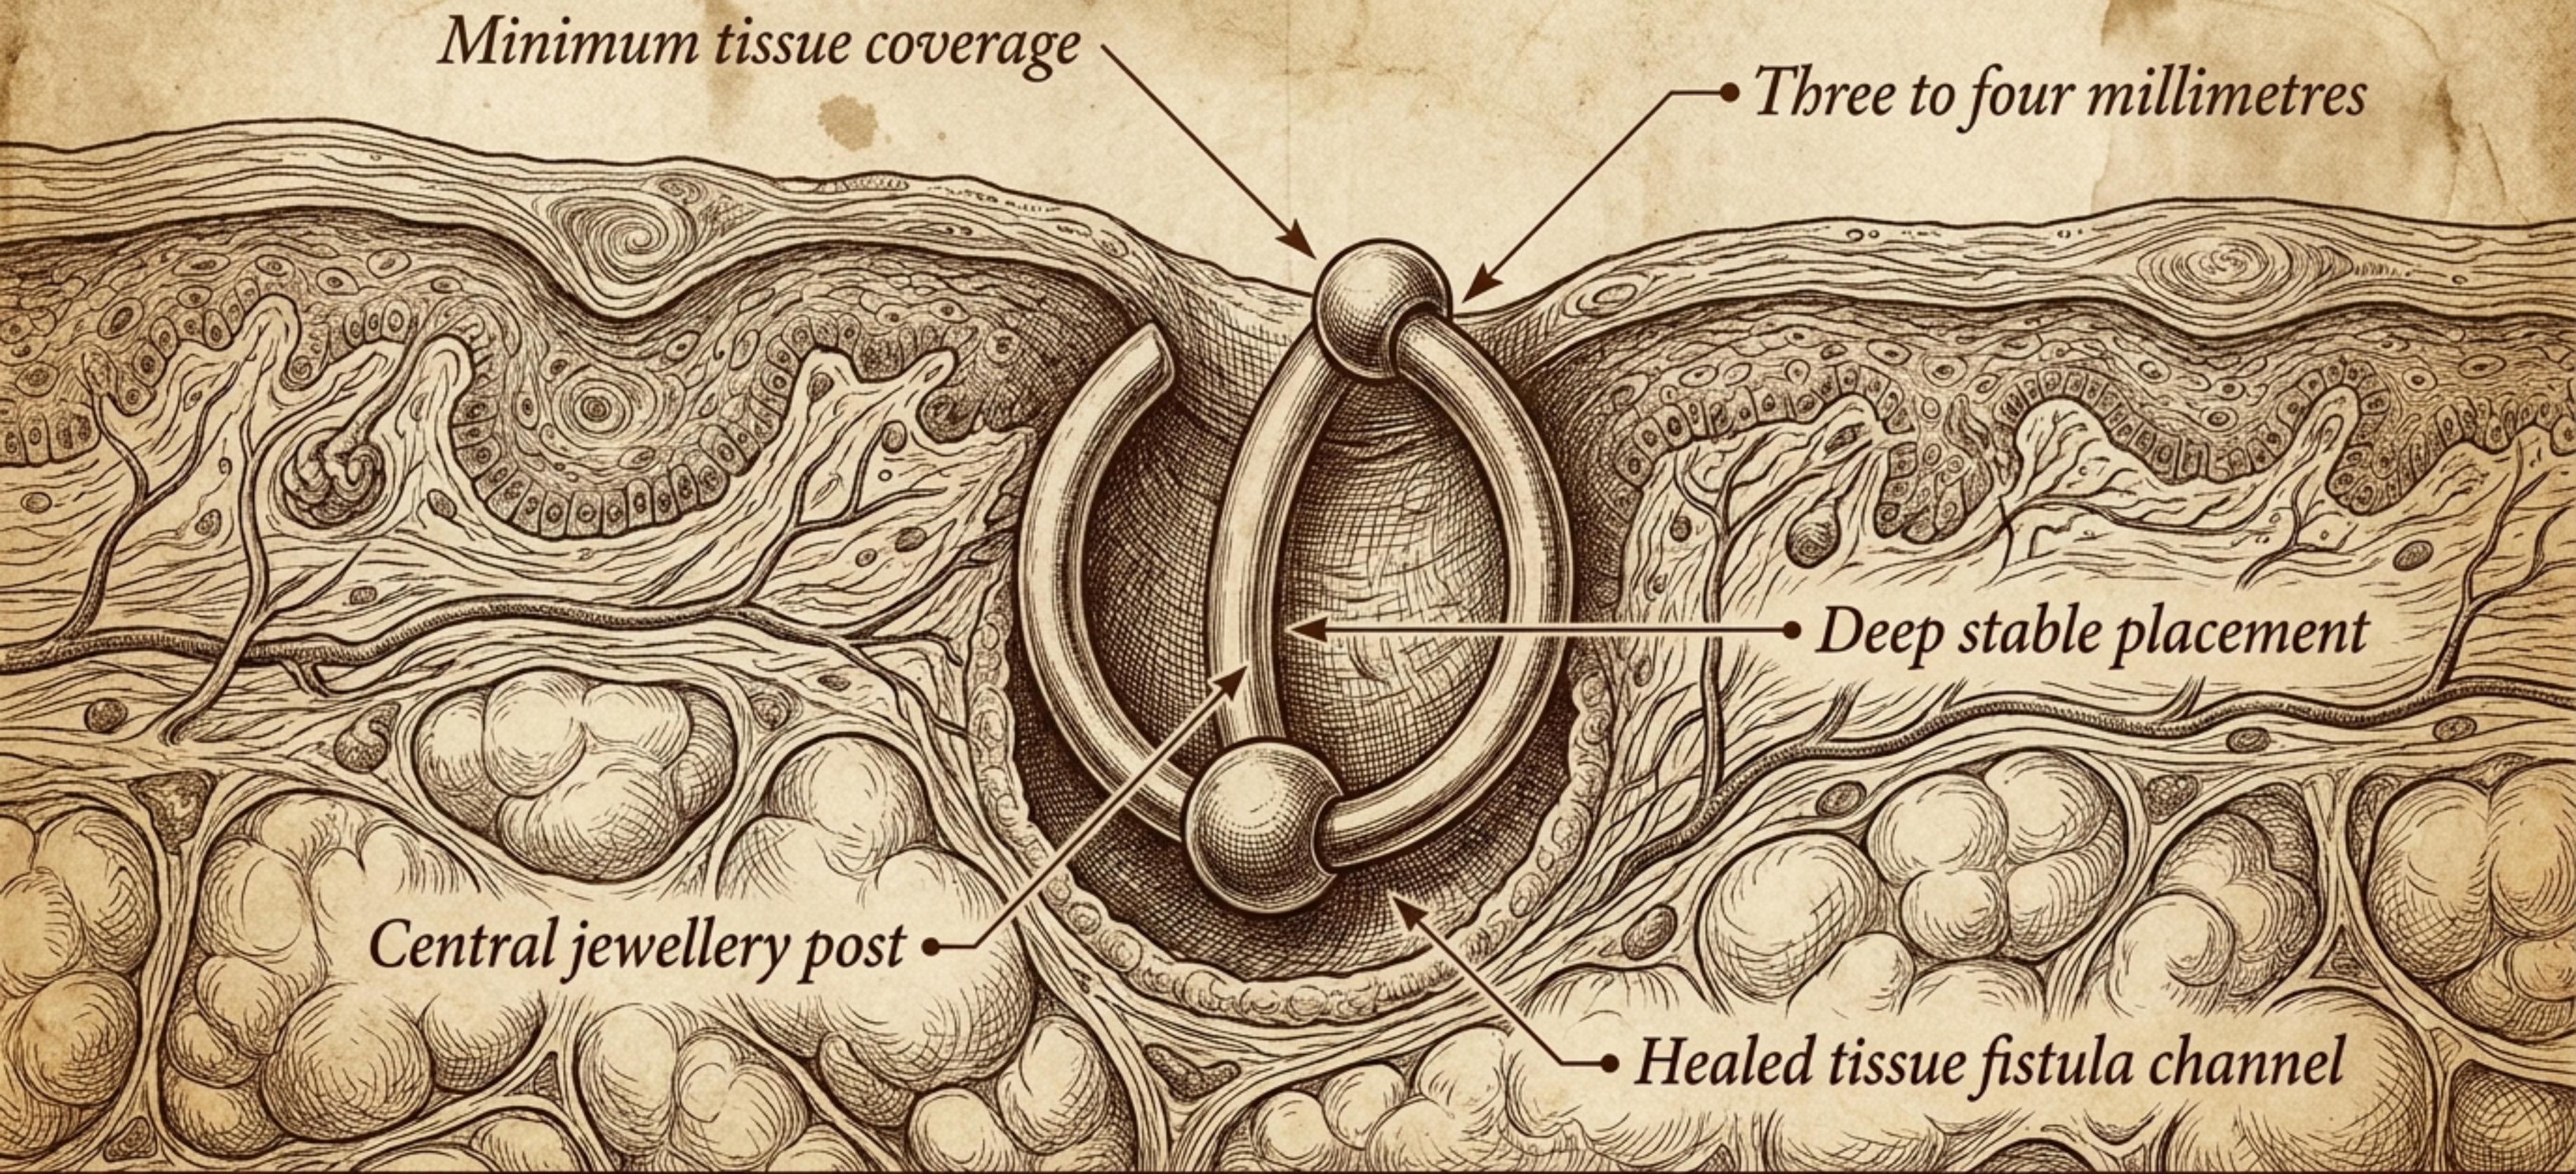

Minimum tissue coverage

• Three to four millimetres

• Deep stable placement

Central jewellery post •

• Healed tissue fistula channel

A stable piercing requires a minimum of three to four millimetres of tissue coverage.
ADEQUATE DEPTH PREVENTS MECHANICAL REJECTION.