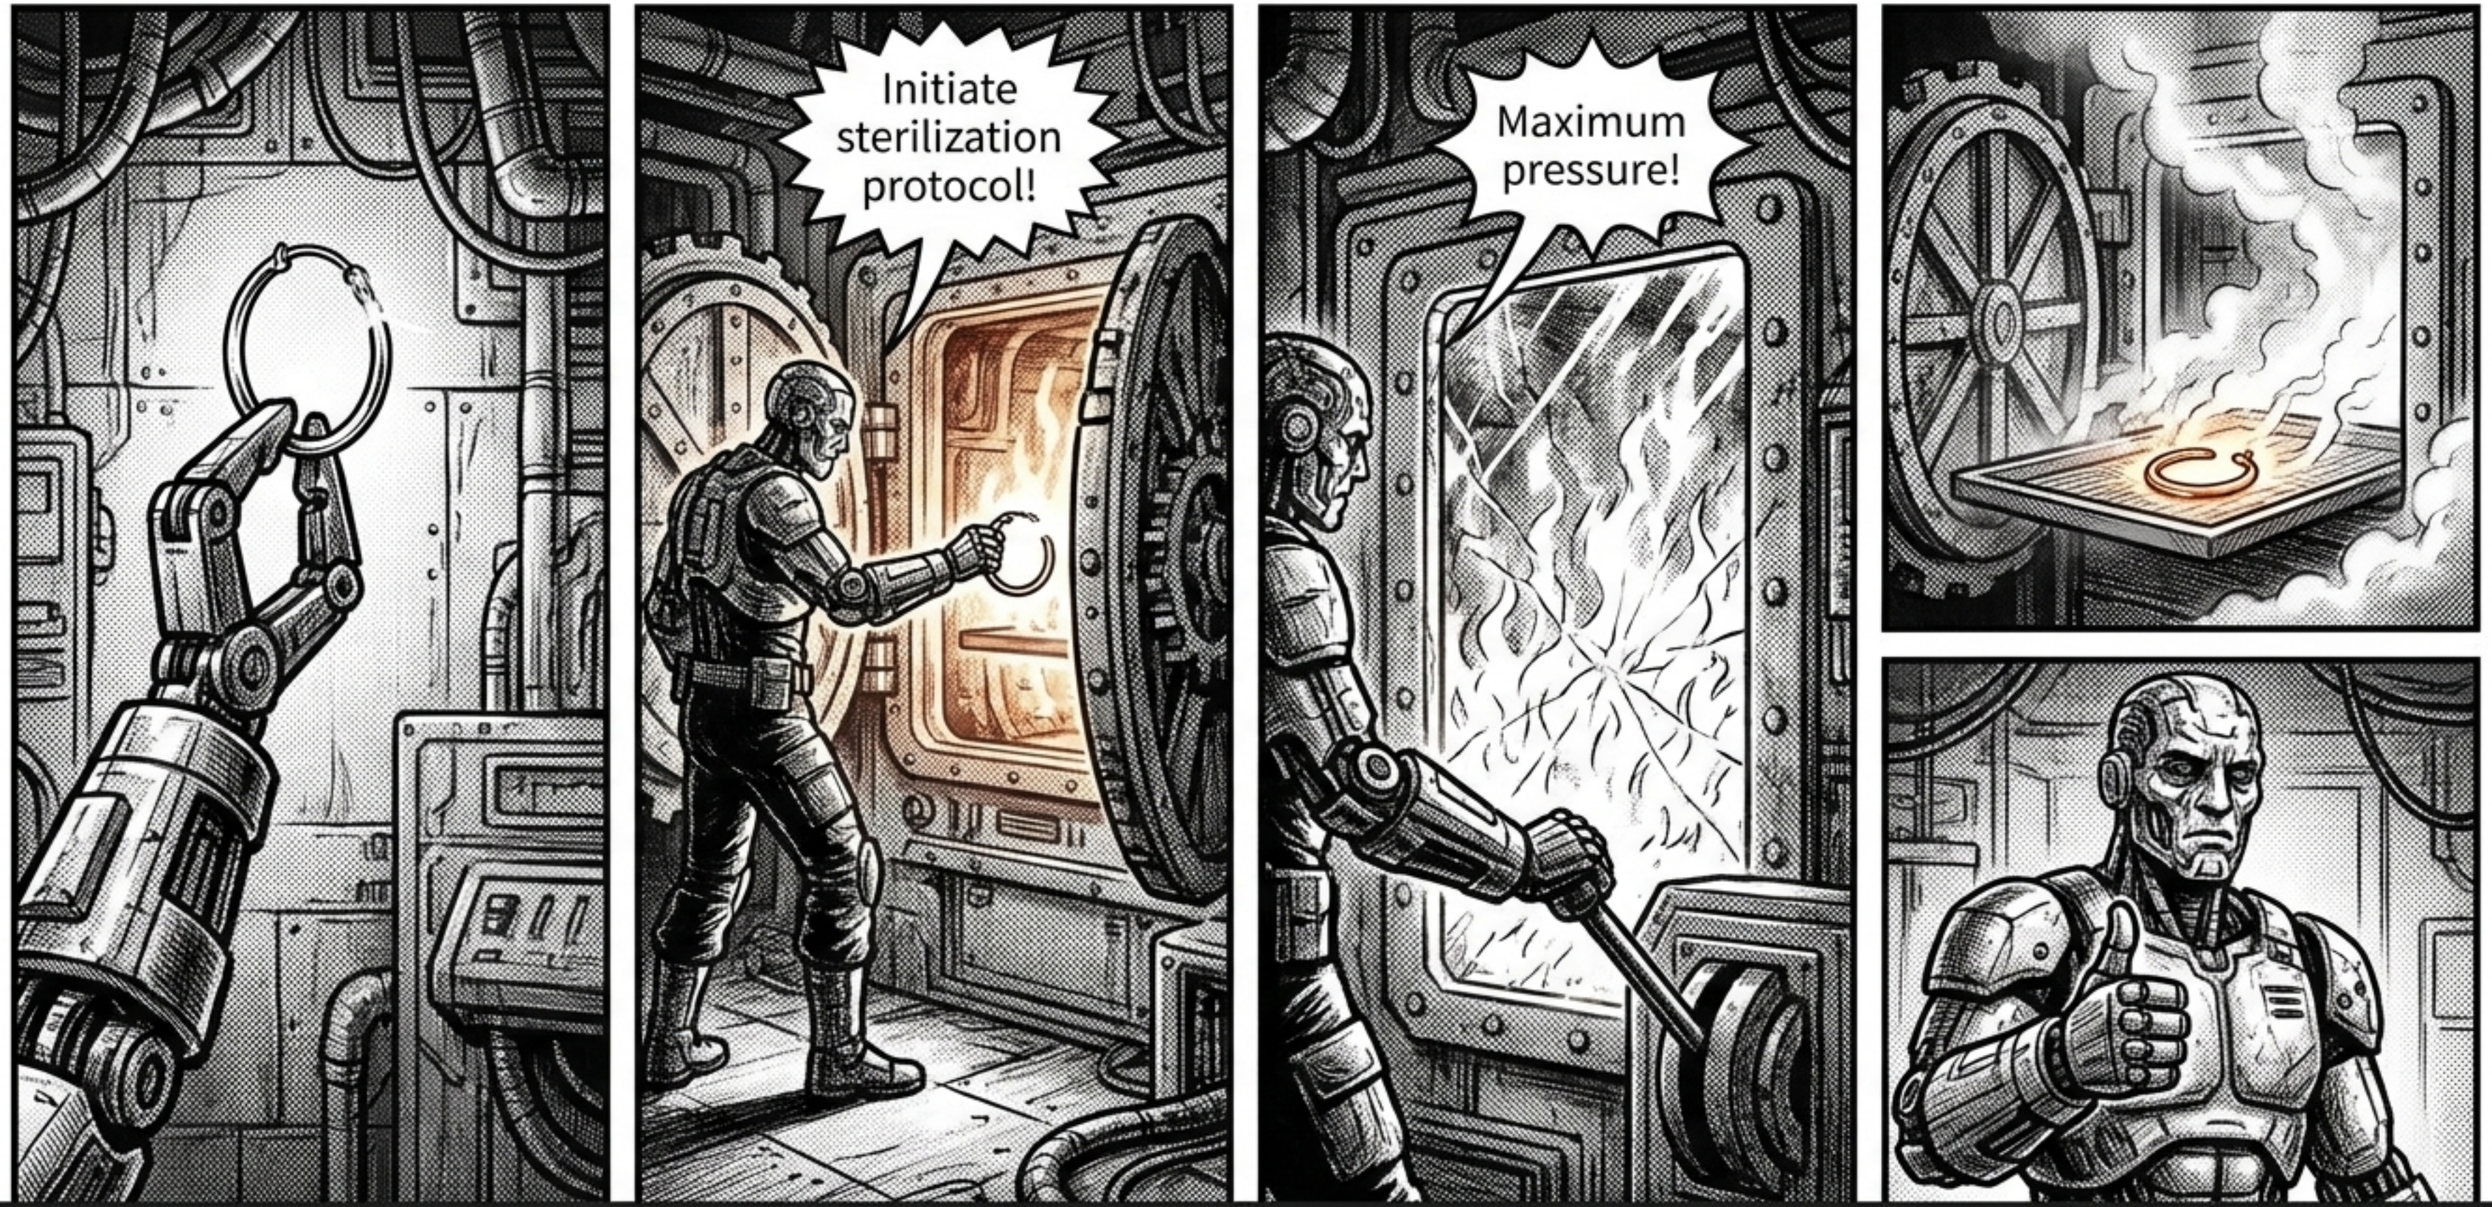

Initial piercing jewelry must withstand the extreme pressure of autoclave sterilization.

Light dusting is a wholly inadequate cleaning protocol.