


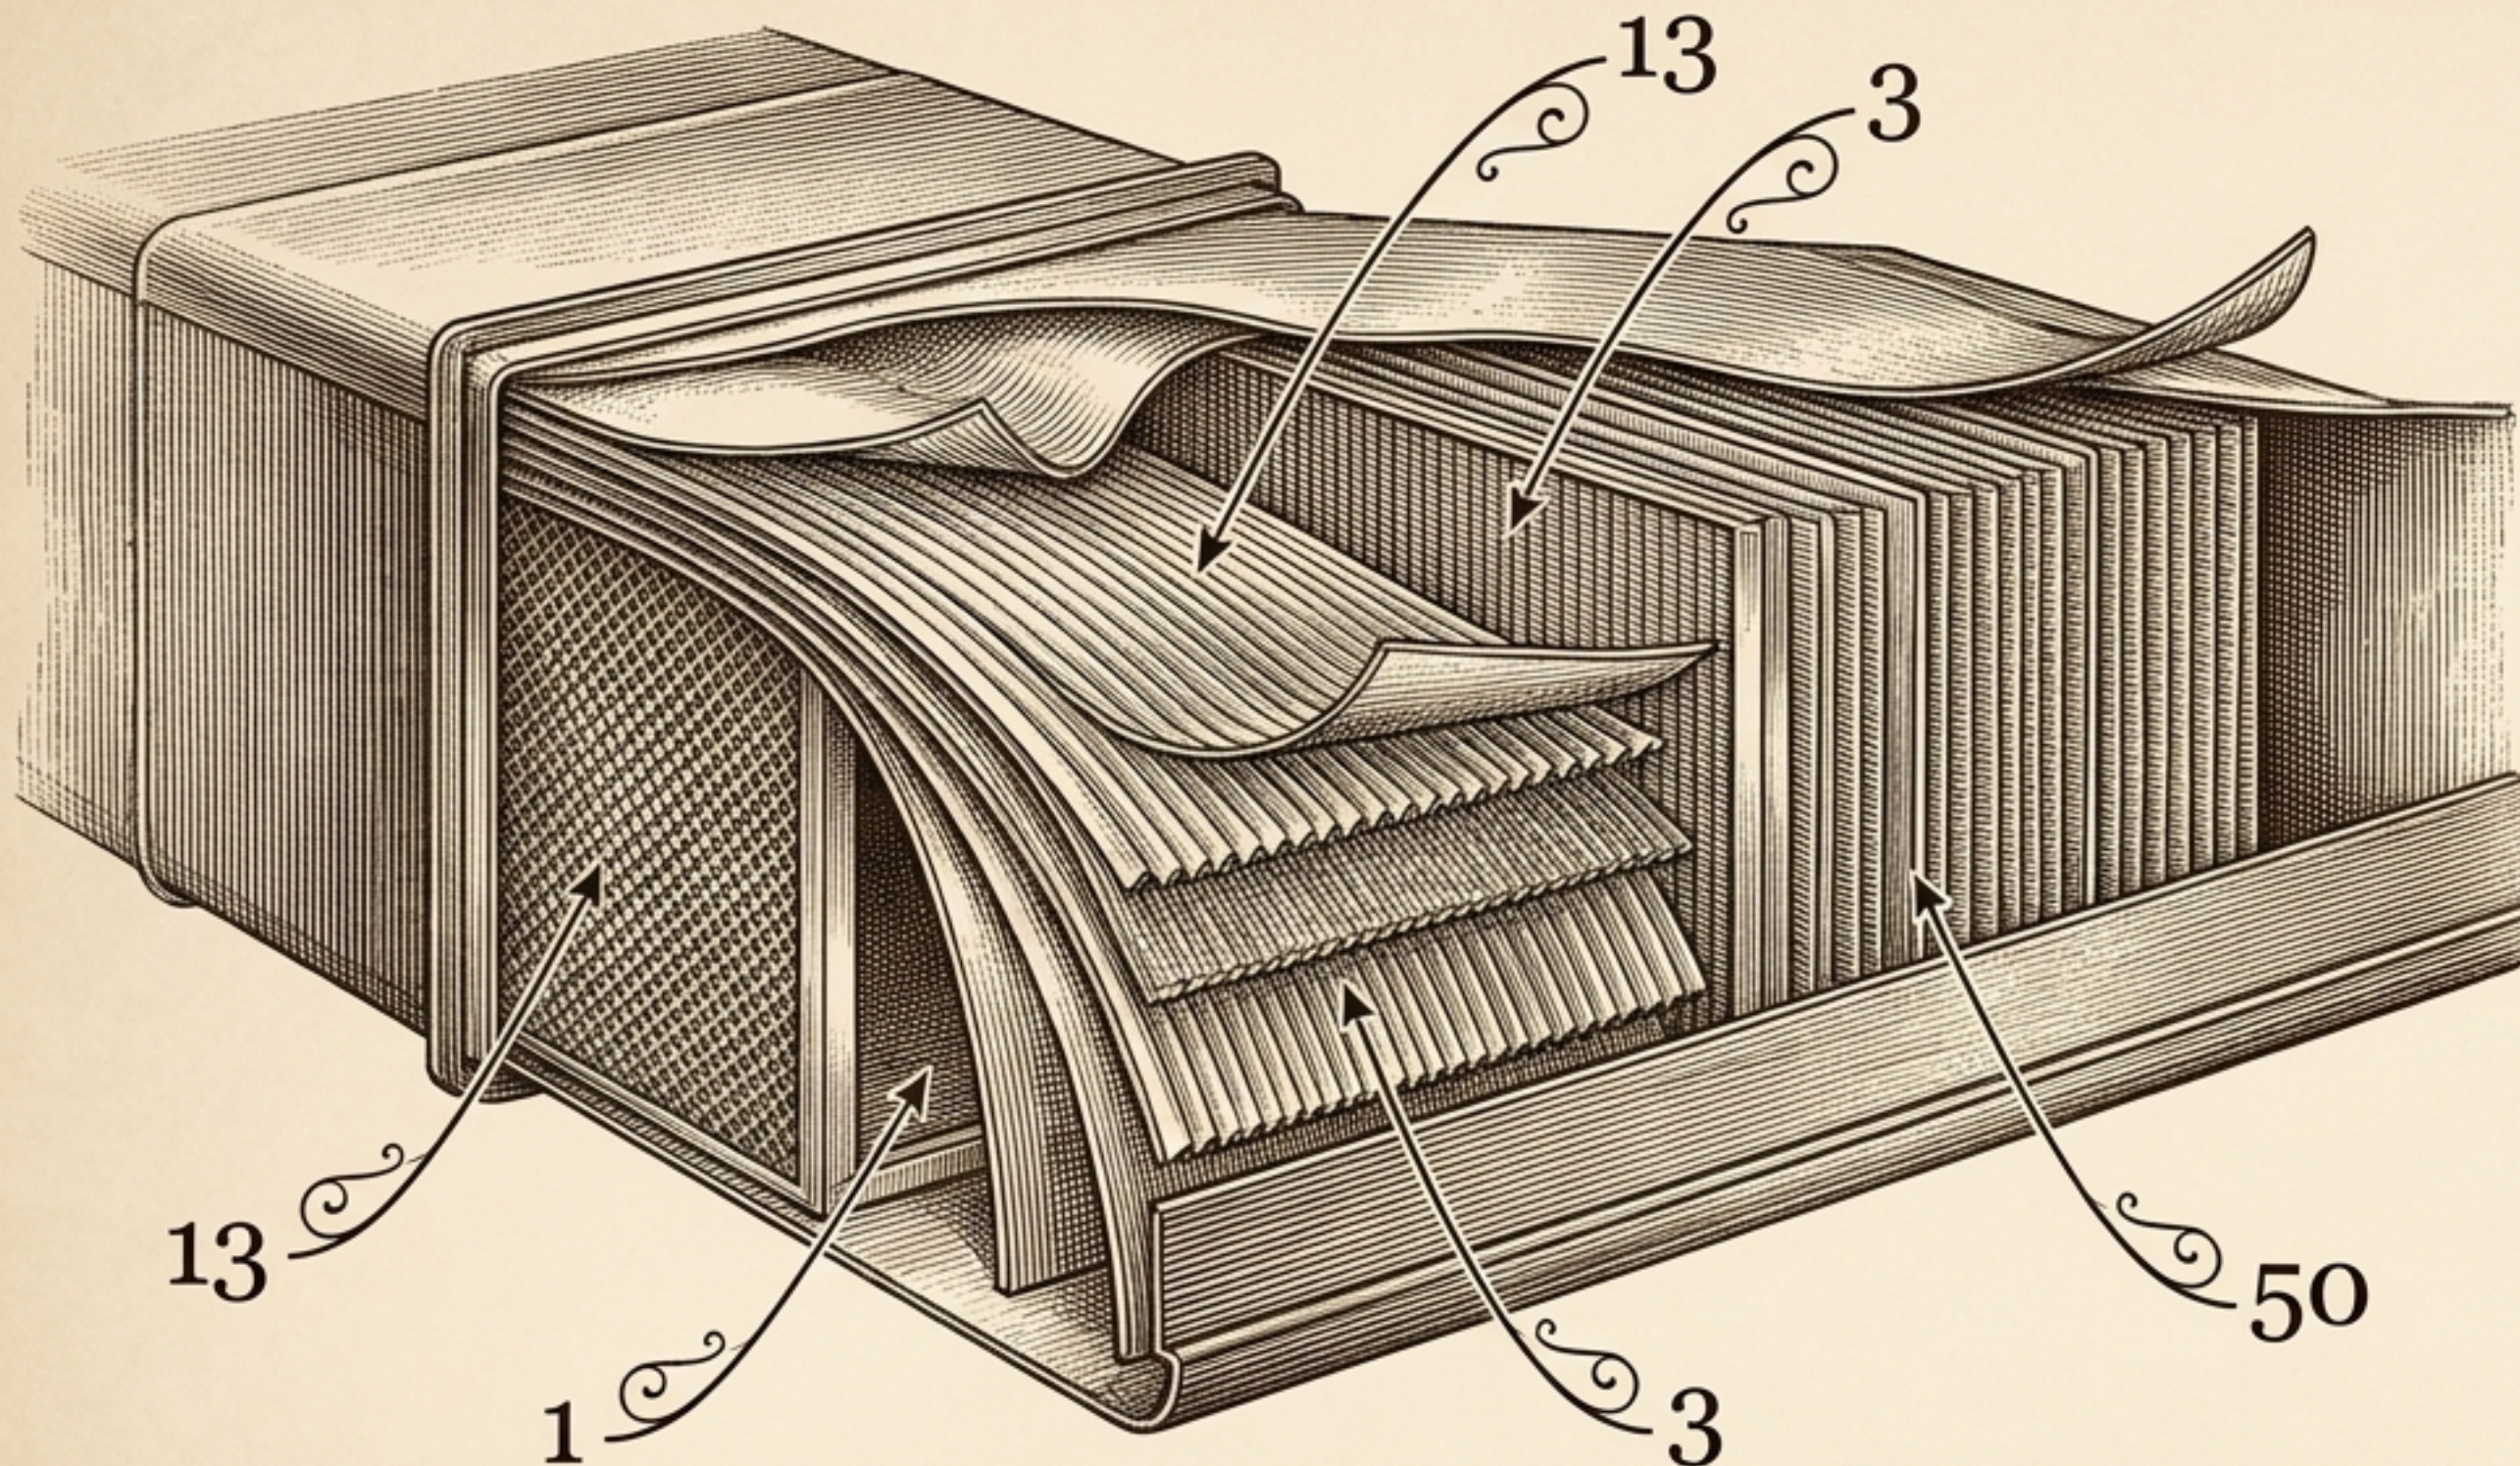

Minimum rated
supply filtration.

Captures bacteria
carrying droplets.

Inspect filter
media monthly.

Replace if resis-
tance increases.

Minimum supply filtration captures most bacteria carrying droplet nuclei.
REPLACE FILTERS EVERY THREE TO SIX MONTHS.