


**Initial piercing roughness target.
0.4 micrometres.**

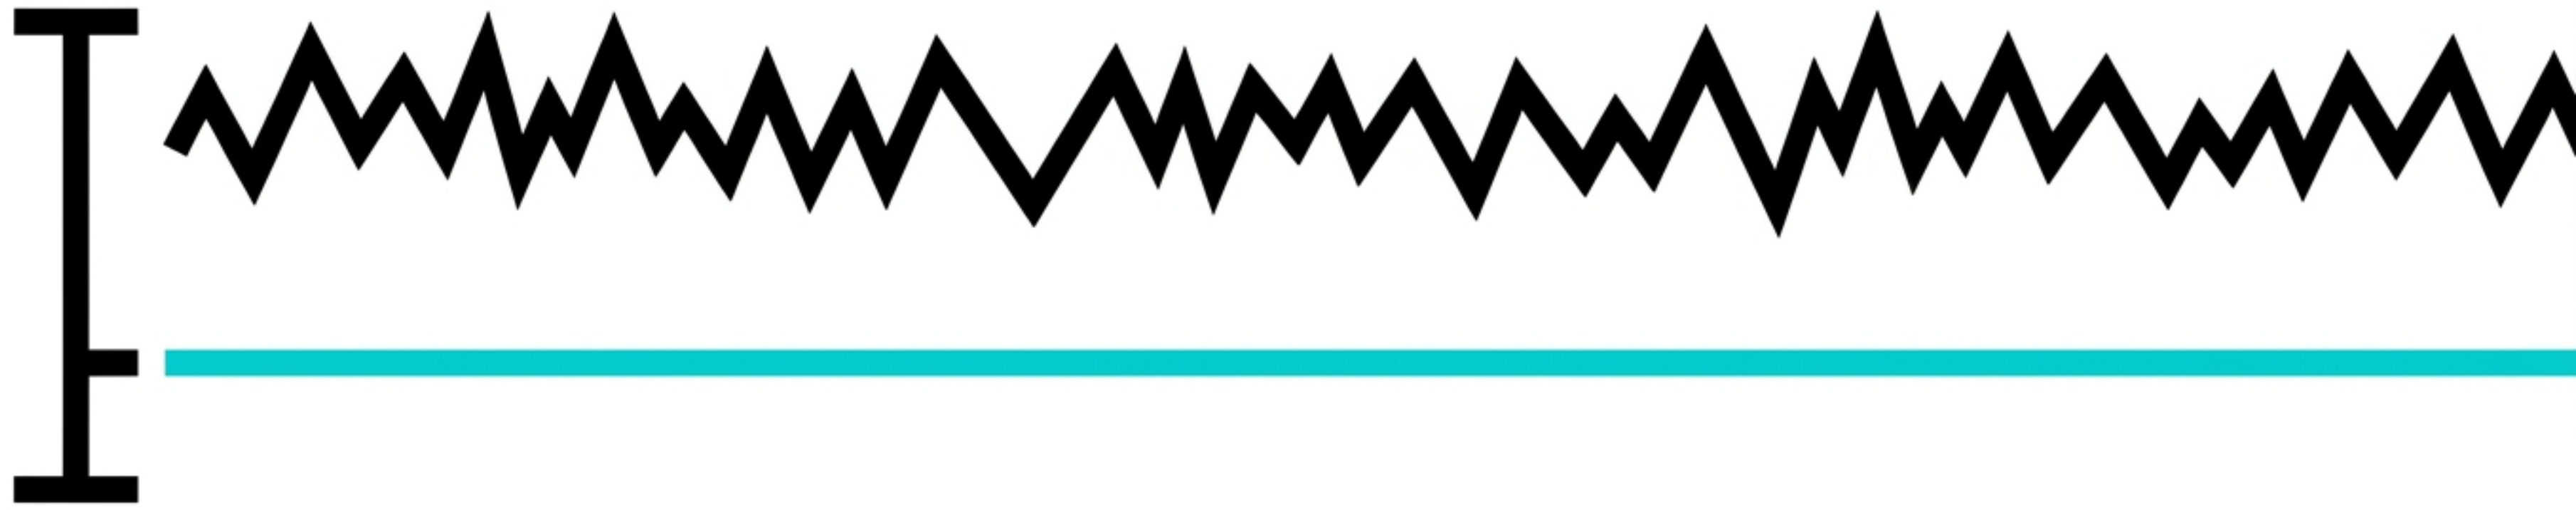

**Mirror polish roughness standard.
0.1 micrometres.**

**Rough surfaces provide anchoring sites for bacterial biofilm.
POLISH DICTATES HEALING SPEED.**