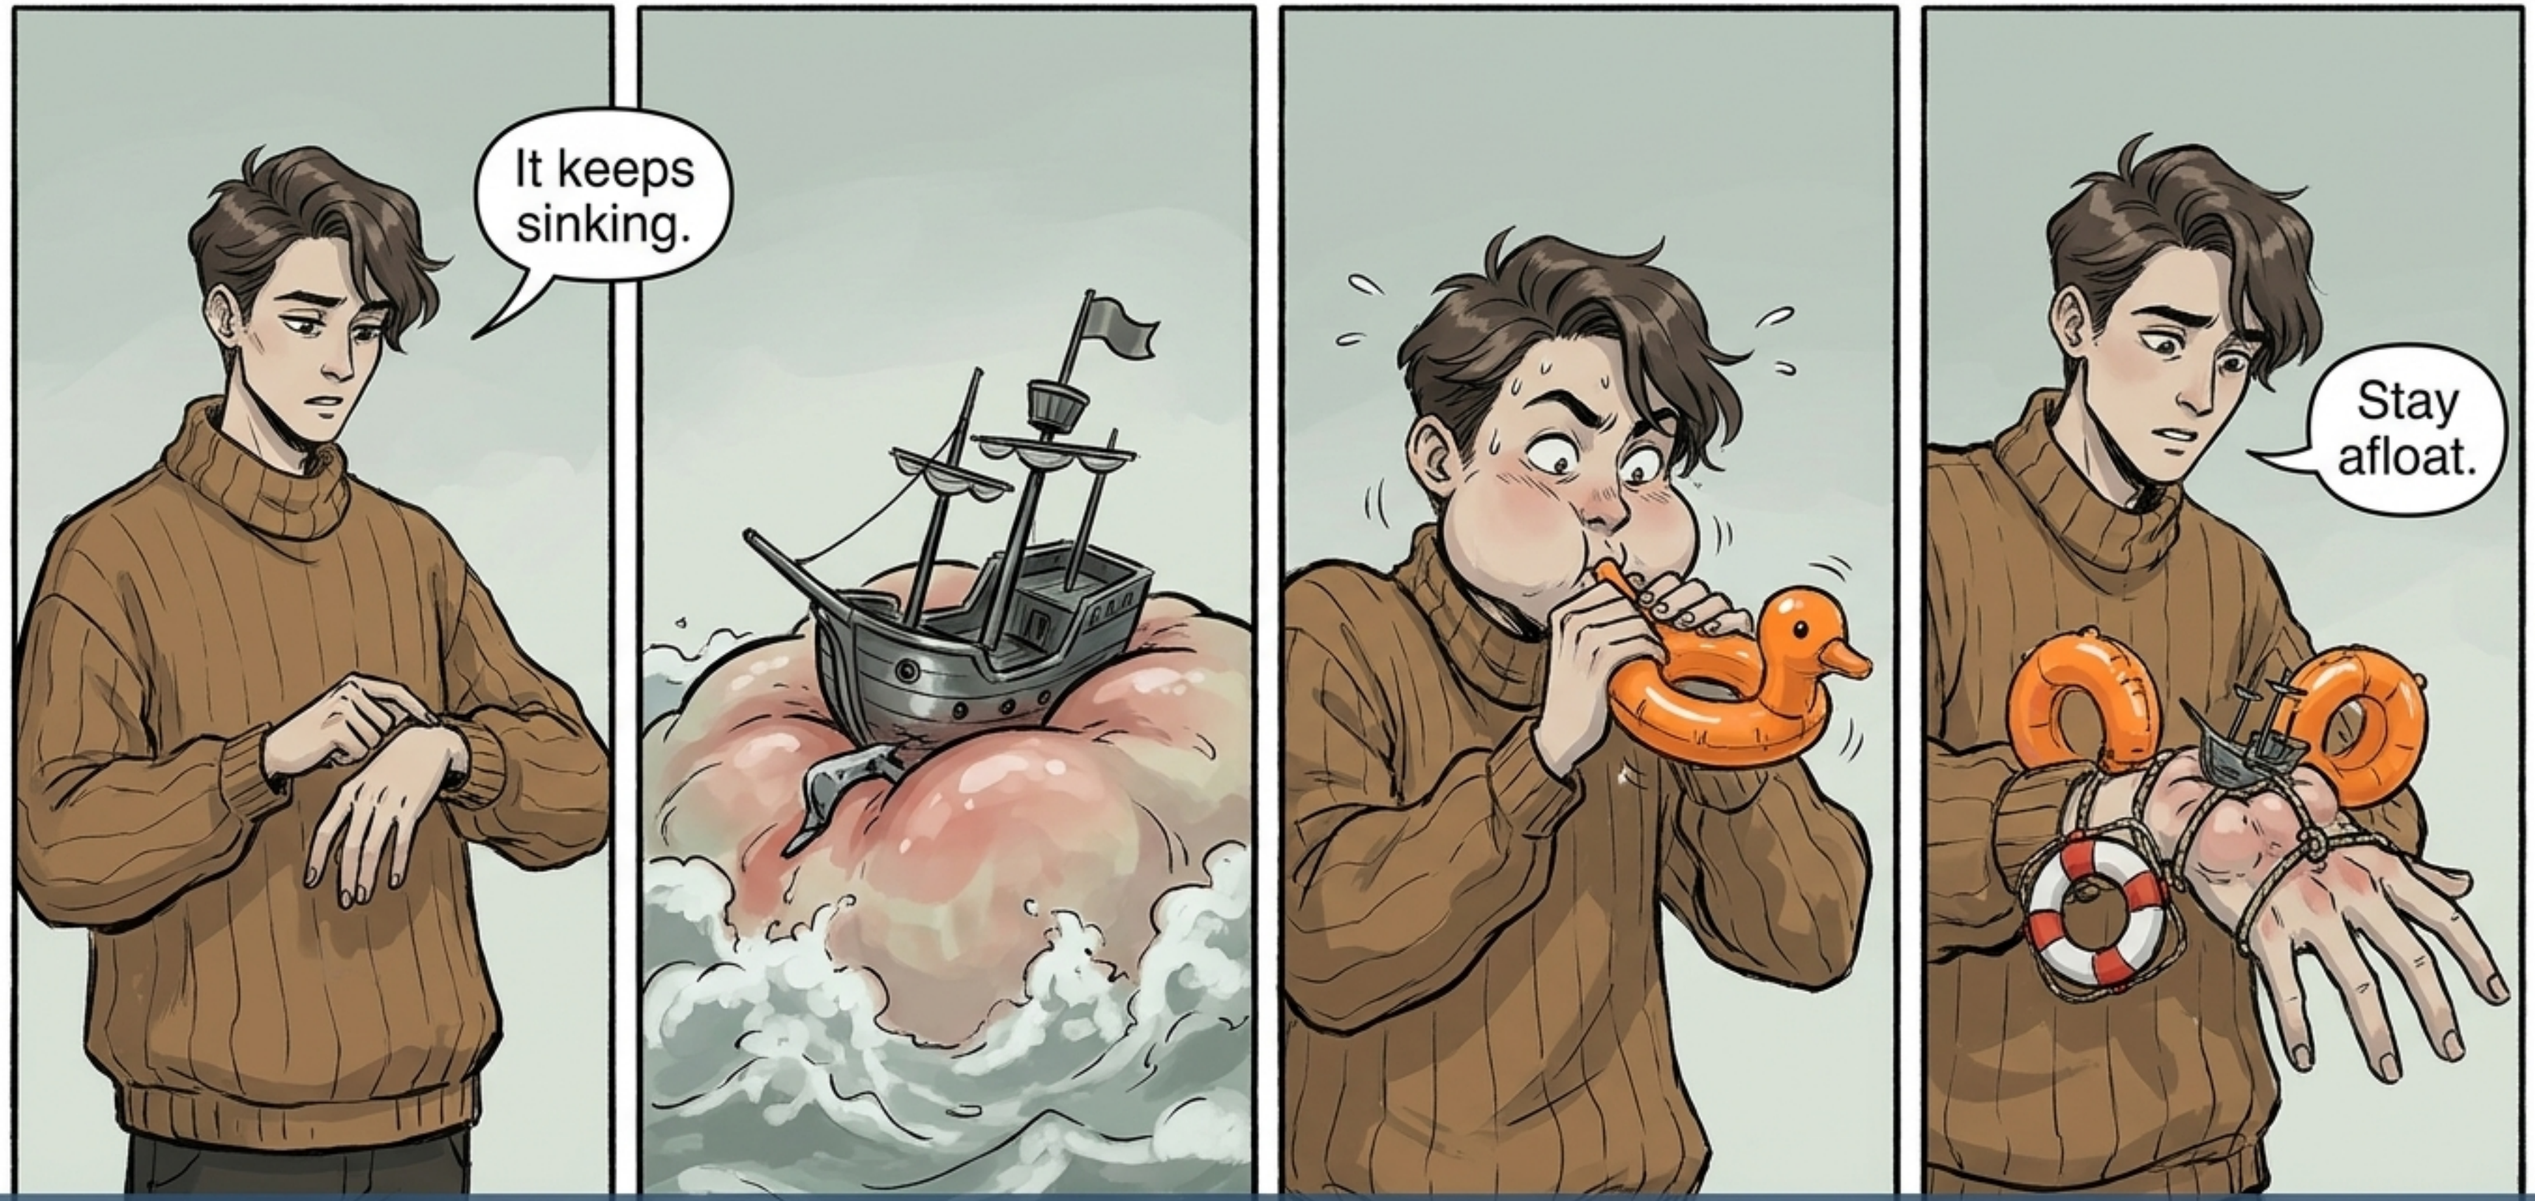

Swelling and pressure cause poorly fitted jewelry to embed deeply into tissue.

The inflatable life preservers deployed far too late.