Sealed bottles harbor bacteria.
Sterility labels offer no guarantee.
Testing reveals hidden risks.

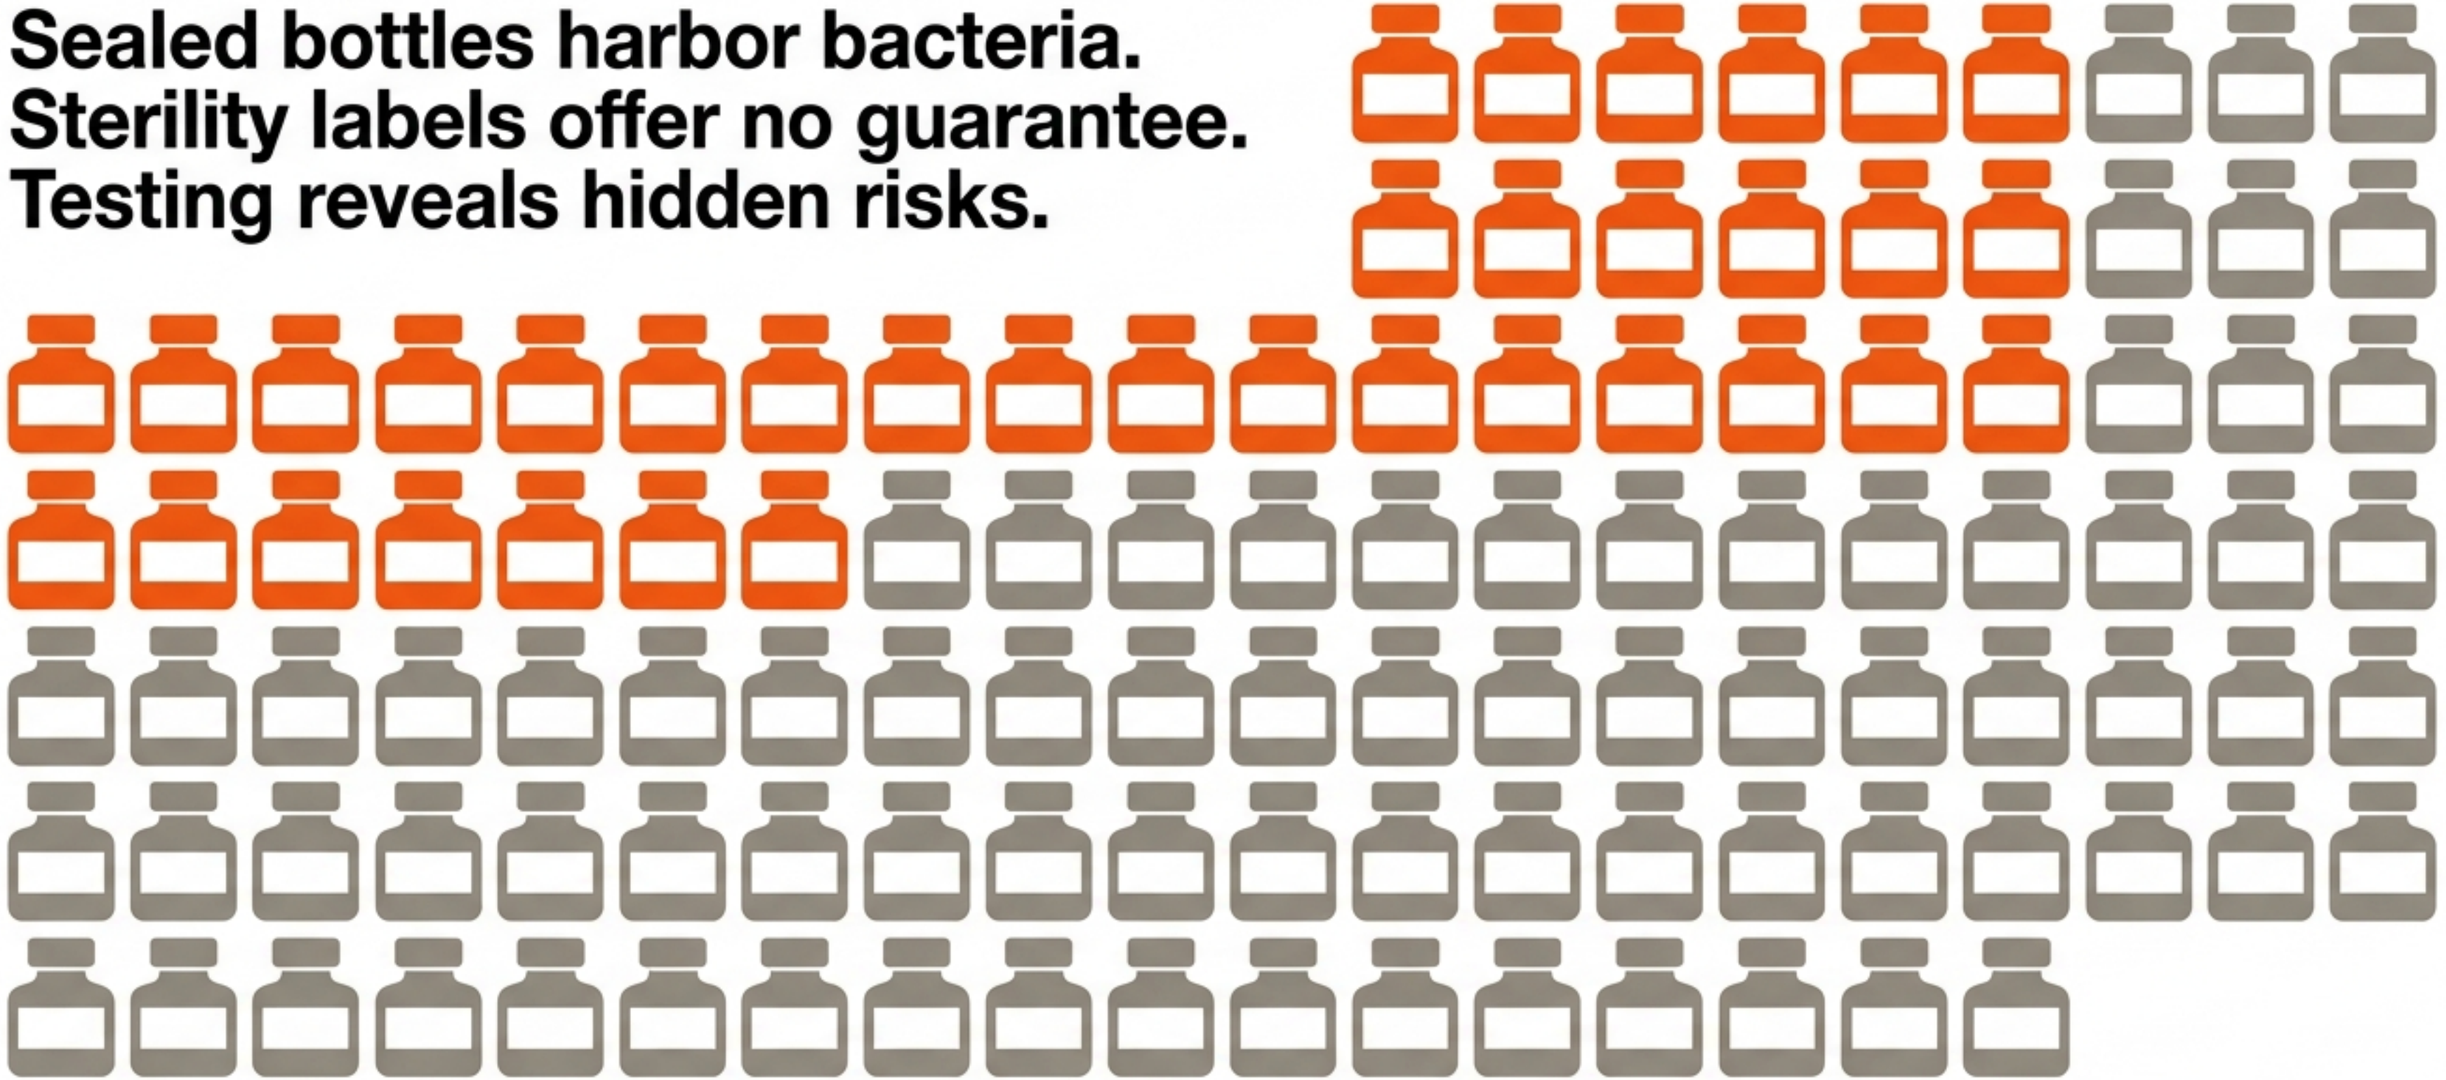

Testing found 26 of 75 samples contained 22 bacteria types.

Sterility claims require verification.