
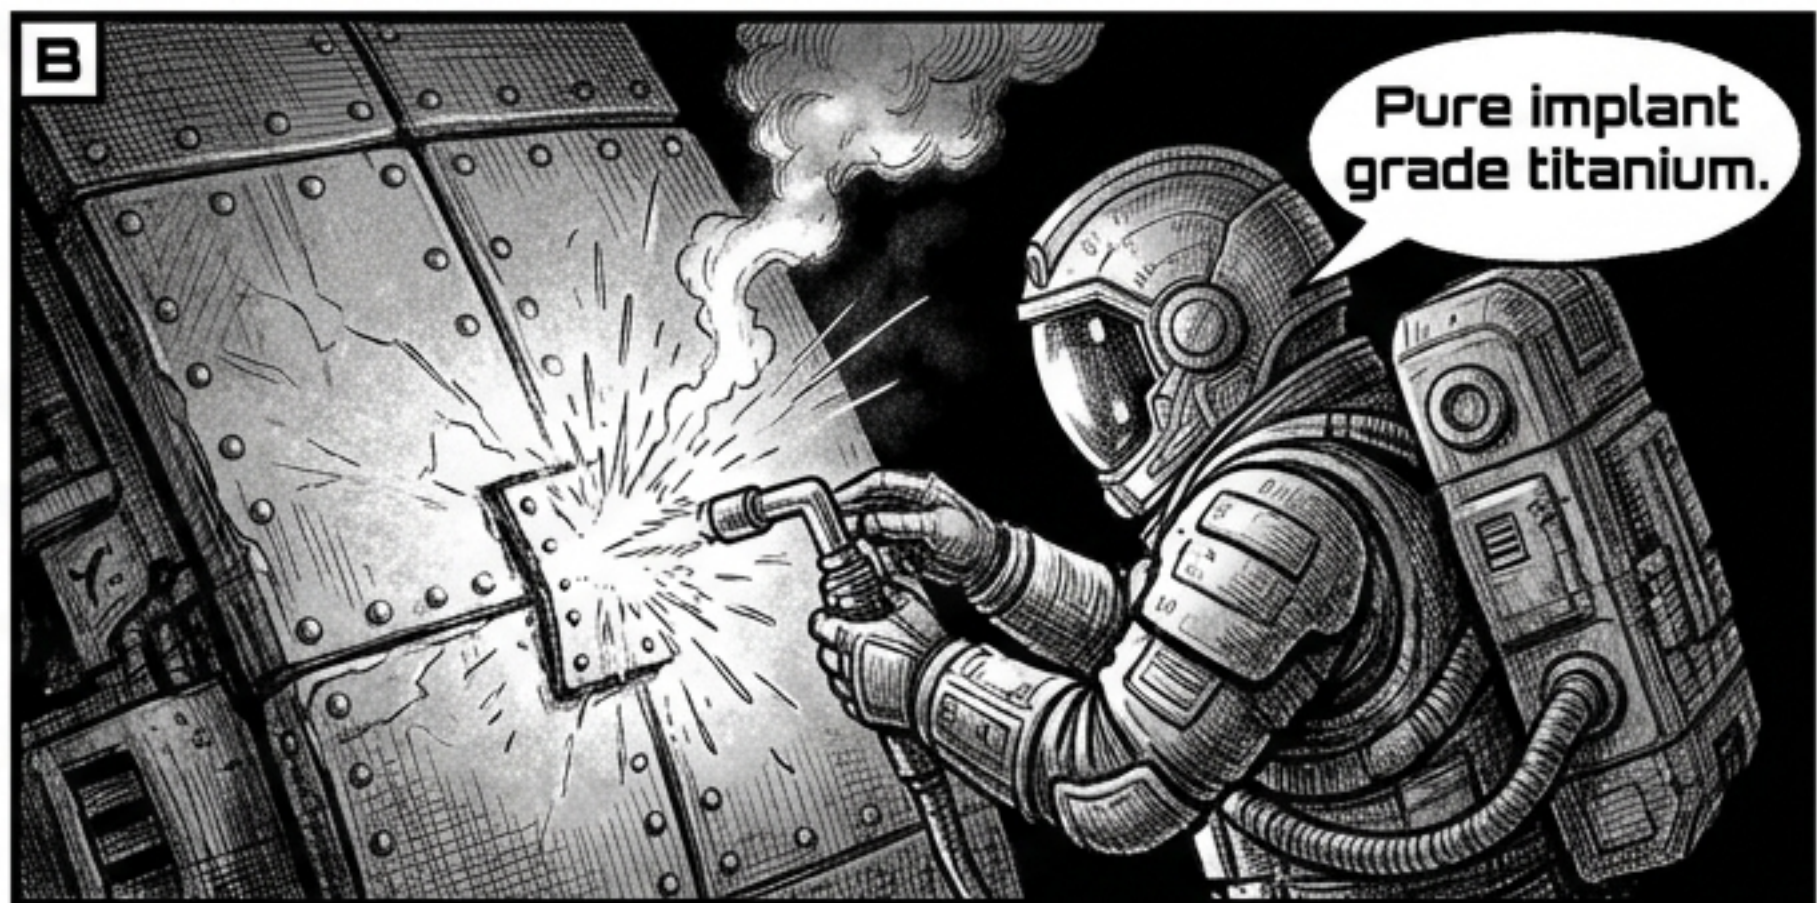


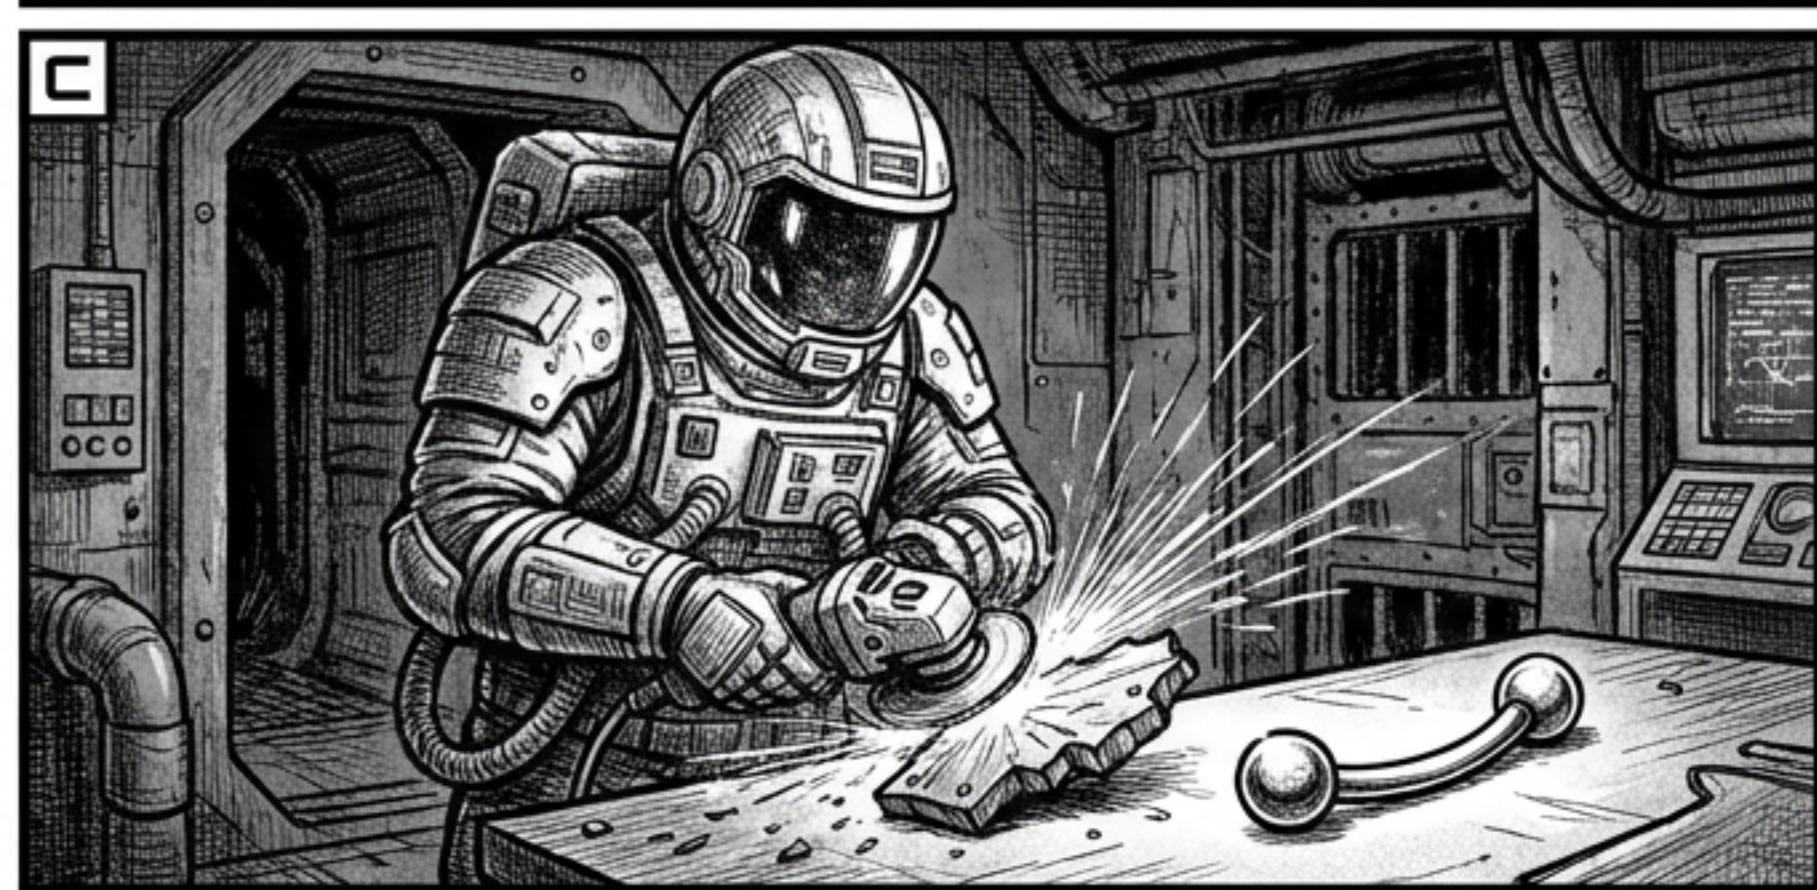

Initial piercing jewellery must be made from verified implant grade titanium or steel to ensure biocompatibility.
Starship hull plating is surprisingly gentle on sensitive earlobes.