


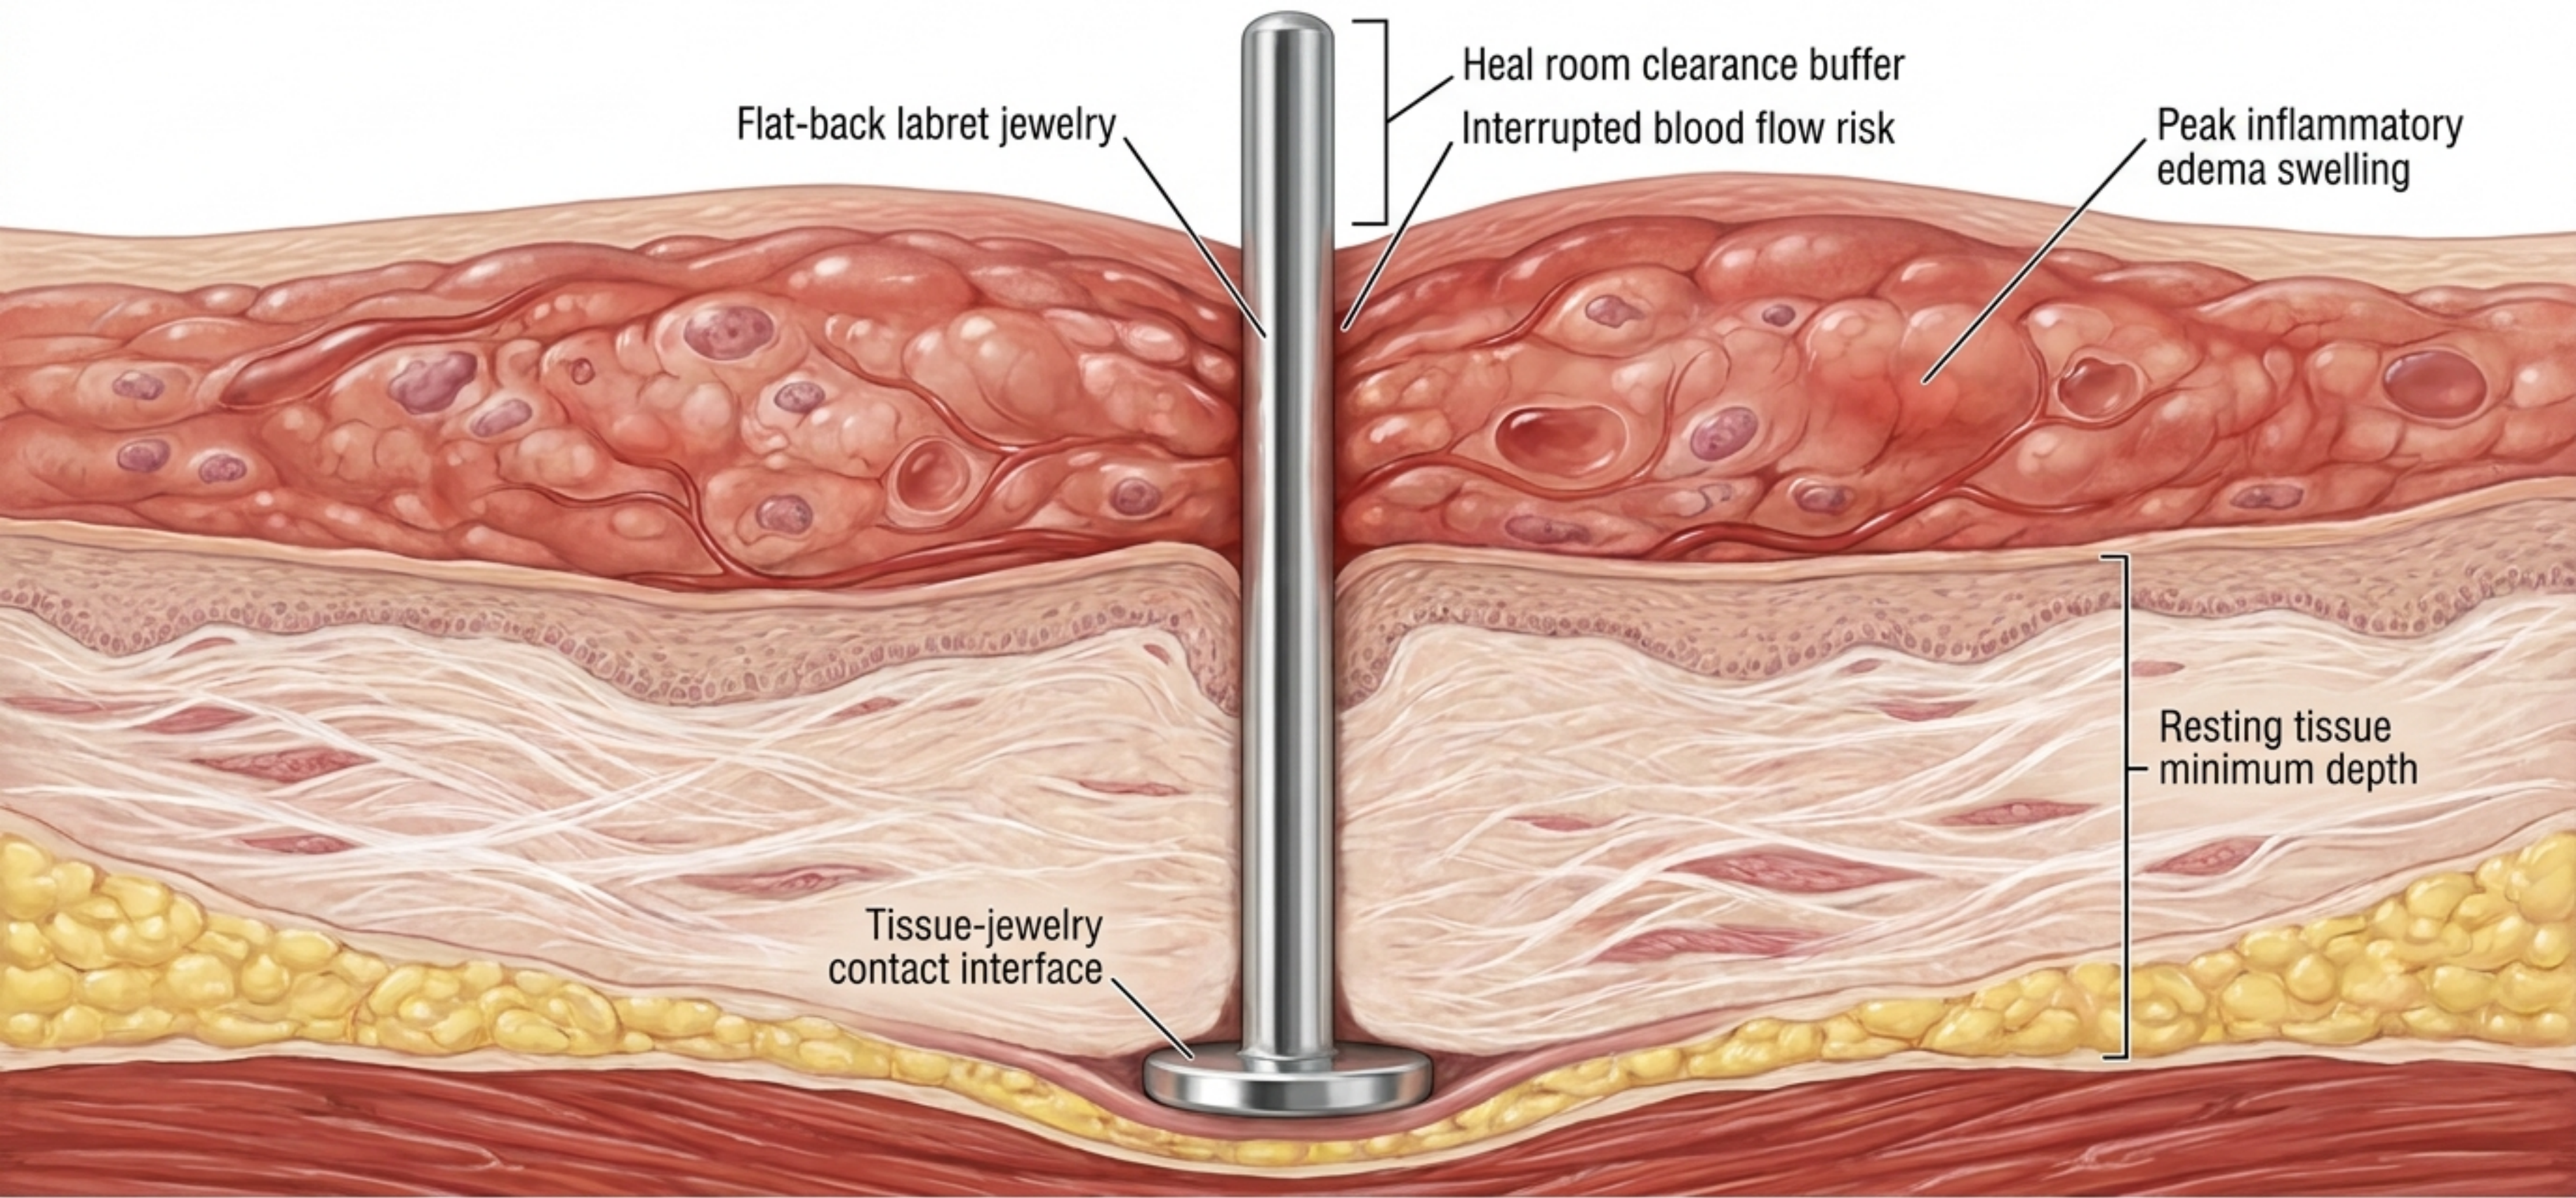

Initial jewelry must accommodate peak inflammatory swelling to prevent focal pressure ischemia.

20–30% HEAL ROOM IS MANDATORY.