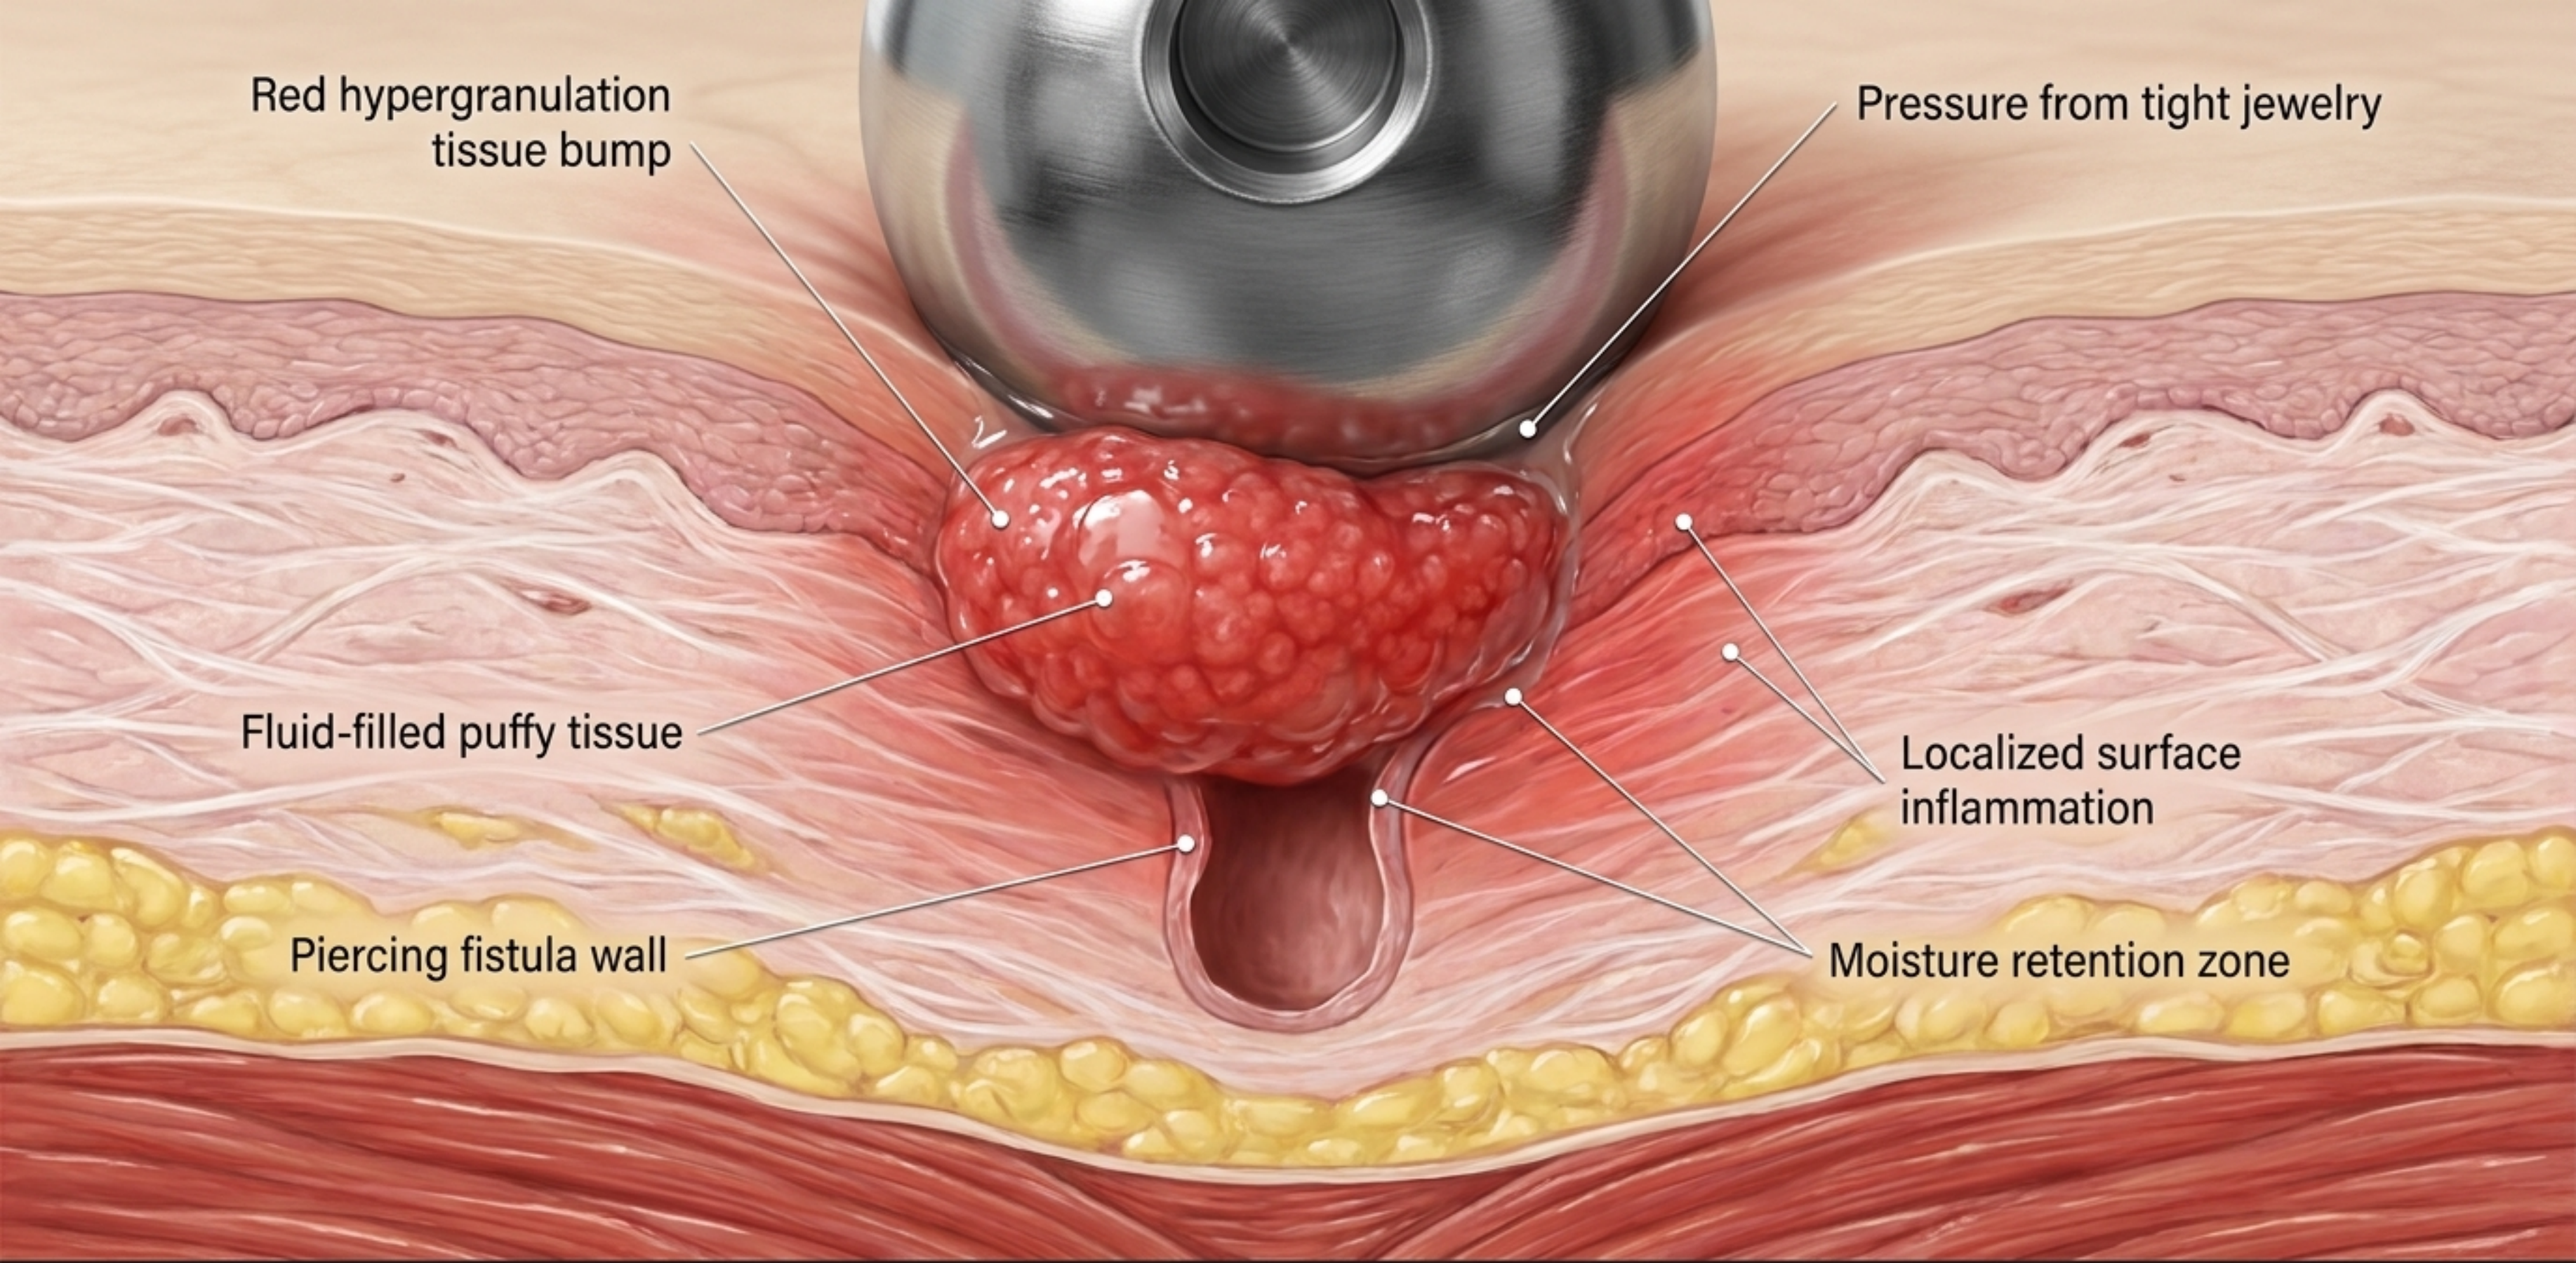

Excess pressure and moisture trigger localized red, puffy hypergranulation tissue at the exit.

RELIEVE PRESSURE TO STOP GRANULATION.